




BRANZ Appraised

Appraisal No. 657 [2016]

K STRIP BASE CLOSERS AND CLADDING TRIMS

Appraisal No. 657 [2016]

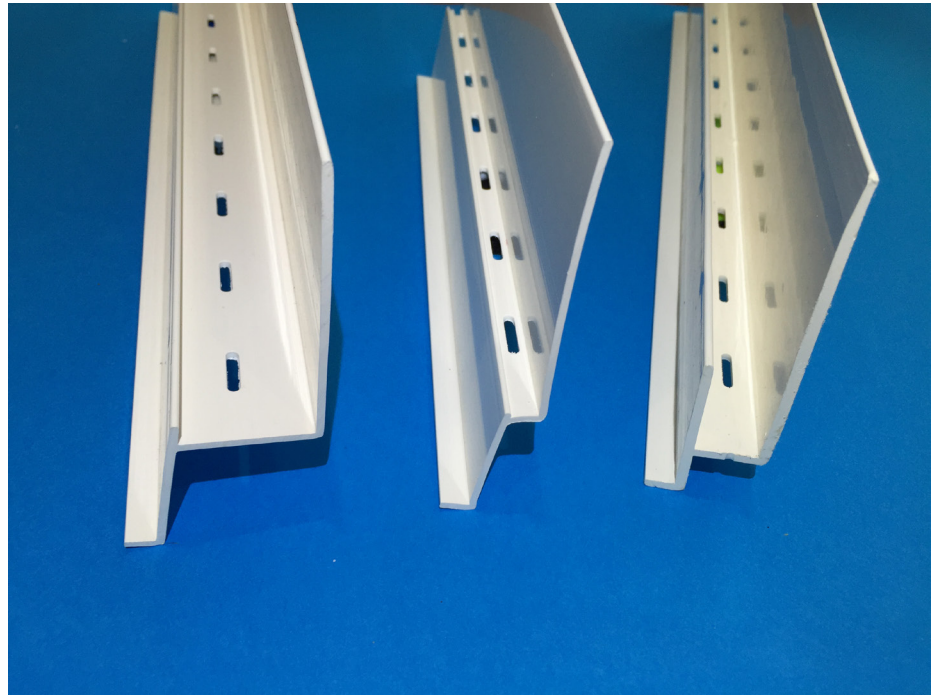

BRANZ Appraisals

Technical Assessments of products for building and construction.



EzyBuild Products Ltd

PO Box 264
Warkworth 0910
Tel: 0800 399 284 [EZY BUILD]
Fax: 09 929 3097
Email: info@ezybuild.co.nz
Web: www.ezybuild.co.nz



BRANZ

BRANZ

1222 Moonshine Rd,
RD1, Porirua 5381
Private Bag 50 908
Porirua 5240,
New Zealand
Tel: 04 237 1170
branz.co.nz



Product

- 1.1 K Strip Base Closers and Cladding Trims are a range of uPVC cavity closers and cladding base trim supports for weatherboard and flat sheet cladding products.

Scope

- 2.1 K Strip Base Closers and Cladding Trims have been appraised for use within the following scope:
 - as a cladding base trim support for direct fixed timber and fibre cement bevelback weatherboards; and,
 - as a cavity closure and base trim support for timber and fibre cement bevelback weatherboards installed over a nominal 20 mm drained cavity; and,
 - as a cavity closure and base trim support for James Hardie Titan® Façade panel; and,
 - as a cavity closure and base trim support for plywood and fibre cement sheet cladding installed over a nominal 20 mm drained cavity; and,
 - as a cavity closure and base trim support for the rigid backing of stucco plaster cladding installed over a nominal 20 mm drained cavity.
- 2.2 K Strip Base Closers and Cladding Trims have been appraised for use with the cladding types detailed within Paragraph 2.1 above. Generic cladding systems within these types must comply with NZBC Acceptable Solution E2/AS1 and proprietary cladding systems must be covered by a valid BRANZ Appraisal.

Building Regulations

New Zealand Building Code (NZBC)

- 3.1 In the opinion of BRANZ, K Strip Base Closers and Cladding Trims if designed, used, installed and maintained in accordance with the statements and conditions of this Appraisal, will meet or contribute to meeting the following provisions of the NZBC:

Clause B2 DURABILITY: Performance B2.3.1 (b), 15 years and B2.3.2. K Strip Base Closers and Cladding Trims meet these requirements. See Paragraphs 8.1 and 8.2.

Clause E2 EXTERNAL MOISTURE: Performance E2.3.2. K Strip Base Closers and Cladding Trims when used to close the drained cavity behind a cladding system will contribute to meeting this requirement. The EzyCorner Cavity Flashing when used as a cavity batten and corner flashing on external and internal corners will contribute to meeting this requirement. See Paragraph 11.1.

Clause F2 HAZARDOUS BUILDING MATERIALS: Performance F2.3.1. K Strip Base Closers and Cladding Trims meet this requirement and will not present a health hazard to people.

- 3.2 This is an Appraisal of an **Alternative Solution** in terms of New Zealand Building Code compliance.

Technical Specification

- 4.1 K Strip Base Closers and Cladding Trims are white uPVC extrusions supplied in 2.2 m lengths. EzyBuild Products Ltd supplies four different profiles:
- K Strip Weatherboard Direct Fix
 - K Strip Weatherboard Cavity Fix
 - K Strip Sheet Cavity Fix
- 4.2 Accessories used with the K Strip Base Closers and Cladding Trims, which are supplied by the building contractor are:
- **Fixings for K Strip** – 40 x 2.5 mm hot-dip galvanised flat-head nails.
 - **Adhesive** – uPVC compatible adhesive for adhering the base closers and cladding trims to the selected cladding as and where required.
 - **Flexible Sealant** – Bostik MS Safe Seal.

Handling and Storage

- 5.1 Handling and storage of all materials supplied by EzyBuild Products Ltd, whether on site or off site, is under the control of the installer. K Strip Base Closers and Cladding Trims must be protected from physical damage and must be stored in clean, dry conditions.
- 5.2 Handling and storage of all materials supplied by the building contractor, whether on or off site, is under the control of the building contractor. Materials must be handled and stored in accordance with the relevant manufacturer's instructions.

Technical Literature

- 6.1 Refer to the Appraisals listing on the BRANZ website for details of the current Technical Literature for the K Strip Base Closers and Cladding Trims. The Technical Literature must be read in conjunction with this Appraisal. All aspects of design, use, installation and maintenance contained in the Technical Literature and within the scope of this Appraisal must be followed.

Design Information

K Strip

- 7.1 K Strip Base Closers and Cladding Trims can be used as an alternative to the cavity base closure specified within NZBC Acceptable Solution E2/AS1, Paragraph 9.1.8.3 and Figure 66.
- 7.2 Punchings in the K Strip Base Closers and Cladding Trims provide a minimum ventilation opening area of 1000 mm² per lineal metre of wall in accordance with the requirements of NZBC Acceptable Solution E2/AS1, Paragraph 9.1.8.3 [b].
- 7.3 The ground clearance to finished floor levels as set out in NZS 3604 must be adhered to at all times. At ground level, paved surfaces, such as footpaths, must be kept clear of the bottom edge of the K Strip Base Closers and Cladding Trims by a minimum of 100 mm, and unpaved surfaces by 175 mm in accordance with the requirements of NZBC Acceptable Solution E2/AS1, Table 18.
- 7.4 At balcony, deck or roof/wall junctions, the bottom edge of the K Strip Base Closers and Cladding Trims must be kept clear of any adjacent surface, or above the top surface of any adjacent roof flashing by a minimum of 35 mm in accordance with the requirements of NZBC Acceptable Solution E2/AS1, Paragraph 9.1.3.
- 7.5 Where a proprietary cladding manufacturer specifies a cladding base trim or cavity closure as part of their system, permission must be obtained from the cladding manufacturer before the cladding base trim or cavity closure is substituted with the K Strip Base Closers and Cladding Trims.
- 7.6 Where the K Strip Base Closers and Cladding Trims are used with other cladding systems not covered by the Appraisal [refer to Paragraph 2.1], designers must detail the junction between K Strip Base Closers and the cladding to meet their own requirements and the performance requirements of the NZBC. Details not included within the Technical Literature have not been assessed and are outside the scope of this Appraisal.

Durability

Serviceable Life

- 8.1 The K Strip Base Closers and Cladding Trims are expected to have a serviceable life of at least 15 years.
- 8.2 The K Strip Base Closers and Cladding Trims will have a durability equivalent to that of the cladding to meet code compliance with NZBC Clause B2.3.2 provided the cladding is maintained in accordance with this Appraisal.

Maintenance

- 9.1 Regular maintenance is essential for exposed sections of K Strip Base Closers and Cladding Trims to continue to meet the NZBC durability performance provision and to maximise their serviceable life.
- 9.2 Regular cleaning [at least annually] of the exposed sections of K Strip Base Closers and Cladding Trims is recommended to remove grime, dirt and organic growth and to maximise the life and appearance of the surface finish. Build-up of residue, mould or dirt can be removed by brushing with a soft brush, warm water and detergent. Abrasive cleaners, thinners, solvents or petrol must not be used to clean the K Strip Base Closers and Cladding Trims.
- 9.3 Regular checks, at least annually, must be made of the wall cladding, flashings and penetrations to ensure they are maintained weathertight and continue to perform their function, to ensure that water will not penetrate the cladding.

Prevention of Fire Occurring

- 10.1 Separation or protection must be provided to the K Strip Base Closers and Cladding Trims from heat sources such as fire places, heating appliances, flues and chimneys. Part 7 of NZBC Acceptable Solutions C/AS1 – C/AS6 and NZBC Verification Method C/VM1 provide methods for separation and protection of combustible materials from heat sources.

External Moisture

- 11.1 In cavity construction, the K Strip Base Closers and Cladding Trims, when installed in accordance with this Appraisal and the Technical Literature, allow the cavity to be drained and open to the exterior at the bottom of the cavity in accordance with NZBC Acceptable Solution E2/AS1, Paragraph 9.1.8.2 [d]. They also provide vermin proofing at the cavity base in accordance with NZBC Acceptable Solution E2/AS1, Paragraph 9.1.8.2 [e].

Installation Information

Installation Skill Level Requirements

- 12.1 Installation must always be carried out in accordance with the Technical Literature and this Appraisal, by, or under the supervision of, a Licensed Building Practitioner [LBP] with the relevant Licence Class.

System Installation

Wall Underlay Installation

- 13.1 The selected wall underlay must be installed by the building contractor in accordance with the underlay manufacturer's instructions prior to the installation of K Strip Base Closers and Cladding Trims.

K Strip Base Closers and Cladding Trims Installation

- 13.2 The appropriate K Strip Base Closer and Cladding Trim section must be selected depending on the cladding system being installed. K Strip Base Closers and Cladding Trims may be cut with a hand saw or drop saw.

- 13.3 The K Strip Base Closers and Cladding Trims must be set to the correct height and line and must be positioned to overhang the bottom plate by a minimum of 50 mm. They are to be installed in continuous lengths and must be mitred at internal and external corners. They must be installed over the building underlay to the wall framing and must be fixed in place with 40 x 2.5 mm hot-dip galvanised flat head nails at approximately 400 mm centres.
- 13.4 When K Strip Base Closers are used with plywood and fibre cement sheet cladding the cavity battens must be checked 3 mm to allow for the thickness of the K Strip Base Closer. Where cavity spacers are required at the base of the cladding these must be 15 mm thick.
- 13.5 The bottom edge of plywood and fibre cement sheets must be sealed before installation.
- 13.6 The selected cladding is fixed to the wall framing directly or over battens in the normal manner in accordance with Acceptable Solution E2/AS1 or the manufacturer's instructions.
- 13.7 A construction adhesive is use to hold the cladding to the K Strip Base Closers and Cladding Trims. This adhesive is additional to the structural fixing of the cladding. Stainless steel screws 20 mm long may also be used to fix plywood and fibre cement sheets at the base to the K Strip Base Closer. These are countersunk and fixed 25 mm from the sheet bottom at 400 mm centres.

K Strip and James Hardie Titan® Panel

- 13.8 When K Strip Base Closers are used with James Hardie Titan® Facade panel, the K-Strip Sheet Cavity trim must be cut and fixed between CLD® Structural Cavity Battens fixed under panel joints.

Finishing

- 13.9 The K Strip Base Closers and Cladding Trims do not require painting at the completion of installation. If the trim is painted, the paint manufacturer's instructions for painting uPVC must be followed.

Basis of Appraisal

The following is a summary of the technical investigations carried out:

Investigations

- 14.1 BRANZ expert opinion on NZBC E2 code compliance for the K Strip Base Closers and Cladding Trims was based on evaluation of all details within the scope and as stated within this Appraisal. The details contained within the Technical Literature have been reviewed, and an opinion has been given by BRANZ technical experts that the system will meet the performance levels of Acceptable Solution E2/AS1 for cavity closures and cavity battens.
- 14.2 A durability opinion has been provided by BRANZ technical experts.
- 14.3 The practicability of installation has been assessed by BRANZ.
- 14.4 The Technical Literature for the K Strip Base Closers and Cladding Trims has been examined by BRANZ and found to be satisfactory.

Quality

- 15.1 The manufacture of the K Strip Base Closers and Cladding Trims has been examined by BRANZ, and details regarding the quality and composition of the materials used were obtained by BRANZ and



found to be satisfactory.

- 15.2 The quality of materials, components and accessories supplied by EzyBuild Products Ltd is the responsibility of EzyBuild Products Ltd.
- 15.3 Quality on site is the responsibility of the installer.
- 15.4 Designers are responsible for the building design, and building contractors are responsible for the quality of installation of the framing systems, building underlays, cavity battens and cladding system in accordance with the instructions of the designer.
- 15.5 Building owners are responsible for the maintenance of the K Strip Base Closers and Cladding Trims and cladding system in accordance with the instructions of EzyBuild Products Ltd and the designer.

Sources of Information

- NZS 3604: 2011 Timber-framed buildings.
- Acceptable Solutions and Verification Methods for New Zealand Building Code External Moisture Clause E2, Ministry of Business, Innovation and Employment, Third Edition July 2005 [Amendment 6, 14 February 2014].
- Ministry of Business, Innovation and Employment Record of Amendments for Compliance Documents and Handbooks.
- The Building Regulations 1992.



BRANZ Appraised
Appraisal No. 657 [2016]

BRANZ Appraisal
Appraisal No. 657 [2016]
24 June 2016

K STRIP BASE CLOSERS AND
CLADDING TRIMS



In the opinion of BRANZ, **K Strip Base Closers and Cladding Trims** are fit for purpose and will comply with the Building Code to the extent specified in this Appraisal provided they are used, designed, installed and maintained as set out in this Appraisal.

The Appraisal is issued only to **EzyBuild Products Ltd**, and is valid until further notice, subject to the Conditions of Appraisal.

Conditions of Appraisal

1. This Appraisal:
 - a) relates only to the product as described herein;
 - b) must be read, considered and used in full together with the Technical Literature;
 - c) does not address any Legislation, Regulations, Codes or Standards, not specifically named herein;
 - d) is copyright of BRANZ.
2. **EzyBuild Products Ltd**:
 - a) continues to have the product reviewed by BRANZ;
 - b) shall notify BRANZ of any changes in product specification or quality assurance measures prior to the product being marketed;
 - c) abides by the BRANZ Appraisals Services Terms and Conditions.
 - d) Warrants that the product and the manufacturing process for the product are maintained at or above the standards, levels and quality assessed and found satisfactory by BRANZ pursuant to BRANZ's Appraisal of the product.
3. BRANZ makes no representation or warranty as to:
 - a) the nature of individual examples of, batches of, or individual installations of the product, including methods and workmanship;
 - b) the presence or absence of any patent or similar rights subsisting in the product or any other product;
 - c) any guarantee or warranty offered by **EzyBuild Products Ltd**.
4. Any reference in this Appraisal to any other publication shall be read as a reference to the version of the publication specified in this Appraisal.
5. BRANZ provides no certification, guarantee, indemnity or warranty, to **EzyBuild Products Ltd** or any third party.

For BRANZ

Chelydra Percy

Chief Executive

Date of Issue:

24 June 2016