



**BUILDING RESEARCH**  
AS: N. OF N.Z.  
**10 MAY 1996**  
LIBRARY  
PRIVATE BAG, PORIRUA, N.Z.

C1/S1B

32 (K2)

December 1995



# **STUDY REPORT**

**No. 67 (1995)**

## **Fire Severities for Structural Fire Engineering Design**

**P. Narayanan**

The work reported here was jointly funded by the Building Research Levy and the Foundation for Research, Science and Technology from the Public Good Science Fund.

ISSN: 0113-3675

## **Preface**

This report details research into the fire loads that are applicable to office type occupancies in New Zealand, as well as identifying a methodology for carrying out fire load surveys that can be applied to other occupancies.

## **Acknowledgements**

The fire load surveys carried out as part of this research project are based on preliminary work carried out by Macdonald Barnett Partners Ltd. Their valuable discussions and guidance are gratefully acknowledged.

The help rendered by Mr. Joop de Ruiter of BRANZ in carrying out the surveys is also gratefully acknowledged.

## **Readership**

This report is intended for fire protection engineers, researchers and code writers.

# **FIRE SEVERITIES FOR STRUCTURAL FIRE ENGINEERING DESIGN**

BRANZ Study Report No. 67

P. Narayanan

## **REFERENCE**

P. Narayanan, 1995. Fire Severities for Structural Fire Engineering Design. BRANZ Study Report 67. Building Research Association of New Zealand. Judgeford, New Zealand.

## **KEYWORDS**

Building Fires, Fire Load, Building Contents, Fire Resistance, Fire Ratings, Structural Engineering.

## **ABSTRACT**

Traditional fire safety design of buildings has been based on the concept of a "fire resistance rating" (FRR). The FRR of part of a building is the period of time for which it does not collapse or spread fire, and is determined in a standard fire resistance test. The required FRR of a construction is specified in building codes and depends on building height, amount of combustible fire load present and other factors. A standard fire test may not always be representative of an actual fire in a building. There are alternative methods of estimating what the real gas "time-temperature" exposure is more likely to be, based on the principles of energy and mass conservation. In the prediction of fire severity using these methods many designers in New Zealand rely greatly on fire load data from Europe and the United States. A survey of the fire loads in several New Zealand insurance offices has been carried out for comparison with data from overseas. Recommendations have been made in this report, based on the findings from this survey. A methodology for carrying out fire load surveys that can be applied to other types of occupancy has also been identified.

# Contents

|   | Page No.  |
|---|-----------|
| <b>1. INTRODUCTION</b> .....  | <b>1</b>  |
| <b>2. BACKGROUND</b> .....  | <b>2</b>  |
| <b>2.1 Fire Severity</b> .....  | <b>2</b>  |
| <b>2.2 Methods for the Prediction of Fire Severity in Firecells</b> ..... | <b>4</b>  |
| 2.2.1 Equivalent Time of Fire Exposure .....                              | 4         |
| 2.2.2 The Swedish Time Temperature Curves .....                           | 5         |
| 2.2.3 Lie's Time-Temperature Curves .....                                 | 6         |
| 2.2.4 Limitations.....  | 9         |
| <b>2.3 Fire Loads</b> .....   | <b>9</b>  |
| 2.3.1 European Fire Load Survey Methodology Applied to New Zealand.....   | 9         |
| 2.3.2 Estimation of Fire Loads .....                                      | 10        |
| 2.3.3 Fixed or Permanent Fire Loads .....                                 | 11        |
| 2.3.4 Movable or Variable Fire Loads.....                                 | 11        |
| 2.3.5 Protected Fire Loads.....   | 11        |
| 2.3.6 Unprotected Fire load .....   | 12        |
| <b>3. FIELD SURVEY - RESULTS AND ANALYSIS</b> .....                       | <b>12</b> |
| <b>3.1 Sample Selection</b> .....   | <b>12</b> |
| 3.1.1 General Observation .....   | 12        |
| <b>3.2 Data Collation</b> .....   | <b>13</b> |
| 3.2.1 Fixed Loads .....   | 13        |
| 3.2.2 Movable Loads .....   | 14        |
| <b>3.3 Statistical Analysis of Data</b> .....                             | <b>14</b> |
| <b>3.4 Engineering Analysis of Data</b> .....                             | <b>18</b> |
| <b>4. CONCLUSIONS AND RECOMMENDATIONS</b> .....                           | <b>21</b> |
| <b>4.1 Conclusions</b> .....  | <b>21</b> |
| <b>4.2 Recommendations</b> .....  | <b>21</b> |
| <b>5. REFERENCES</b> .....  | <b>22</b> |

# Figures

|  | Page No. |
|--|----------|
| Figure 1 : Typical Time-Temperature Curve for Natural Fires in Enclosed Firecells .....            | 3        |
| Figure 2 : Simplified Flow Chart Showing the Steps in Fire Engineering Design.....                 | 3        |
| Figure 3 : Swedish Temperature-Time Curves For a Fully Developed Compartment Fire .....            | 6        |
| Figure 4 : Time-Temperature Curves for Ventilation Controlled Fires.....                           | 8        |
| Figure 5 : Comparison Between Time-Temperature Curves With and Without Decay Phase ....            | 9        |
| Figure 6 : Normal Distribution for Fixed Fire Load in Life Offices .....                           | 16       |
| Figure 7 : Normal Distribution for Movable Fire Load in Life Offices .....                         | 16       |
| Figure 8 : Normal Distribution for Total Fire Load in Life Offices .....                           | 16       |
| Figure 9 : Lie (1988) Time-Temperature Curves for Average Fire Load Values for .....               |          |
| Samples A1-A5.....   | 19       |
| Figure 10 : Lie's Time-Temperature Curves for Sample A3 (Assuming Various Opening<br>Factors)..... | 20       |

# Tables

|  | Page No. |
|--|----------|
| Table 1 : Conversion Factor $k_p$ .....  | 5        |
| Table 2 : Combination Coefficient for Protected Fire Loads Based on the Probability of<br>Failure..... | 12       |
| Table 3 : Ventilation Characteristics of Firecells Surveyed .....                                      | 13       |
| Table 4 : Building Type and Aspect Ratio Information for Firecells Surveyed.....                       | 13       |
| Table 5 : Fire Loads in Life Offices in Wellington City (Survey Figures).....                          | 15       |
| Table 6 : Results of the Normal Distribution of Fire Loads in New Zealand Life Offices .....           | 17       |
| Table 7 : Comparison of New Zealand Life Office Data With Data for Offices From<br>CIB W14 Study ..... | 17       |
| Table 8 : $F_d$ and $K_d$ Values for Fire Loads (CIB W14, 1986).....                                   | 18       |
| Table 9 : Comparison of the Time-Temperature Results from Lie's Plot with the Swedish<br>Curves.....   | 20       |

## Definitions

|                |   |
|----------------|---|
| FHC            | Fire Hazard Category: The number (graded 1 to 4 in order of increasing severity) used to classify purpose groups or activities having a similar hazard and where fully developed fires are likely to have similar impact on the structural stability of the building. |
| Firecell       | Any space, including a group of contiguous spaces, on the same or different levels within a building, which is enclosed by any combination of fire separations, external walls, roofs and floors.   |
| Fire Intensity | The rate of release of calorific energy in Watts, determined either theoretically or empirically, as applicable.  |
| Fire Load      | The sum of the net calorific values (at ambient moisture content, measured in MJ) of that fuel in a firecell which can reasonably be expected to burn, including furnishings, built-in and removable materials, and building elements.                                |
| FLED           | Fire Load Energy Density: The total fire load divided by the firecell floor area. In this calculation, the floor area includes circulation and service spaces, but excludes exitways and protected shafts.  |
| $A_v$          | Total area available for ventilation  |
| $A_f$          | Total floor area  |
| $A_t$          | Total bounding surface area including window openings   |

# 1. INTRODUCTION

Fire is one of the major causes of loss of life and property in buildings. In New Zealand, traditional fire safety design of buildings has been based on the concept of a "fire resistance rating" (FRR). The FRR of part of a building is the length of time for which it does not collapse or permit spread of fire, and is determined in a standard fire resistance test eg AS 1530 Part 4 (SAA, 1990). The intensity and duration of fire in buildings varies greatly, depending on the amount and surface area of the combustible material present and the available ventilation. Thus, the standard fire test where the fuel and ventilation are controlled may not be representative of an actual fire in a building.

Fire engineering analytical design methods have been developed and applied overseas, particularly in Sweden and Japan. The various fire engineering design approaches and methodologies have been reviewed by Wade (1991). These methods are aimed at making more reliable estimates of the structural performance of building structures under fire conditions. The process requires knowledge about the following:

- how the fire develops (ie how hot and for how long?)
- how the structure responds (does it collapse?).

Knowledge about the fire enables the time-temperature conditions in a space to be estimated. This will depend on factors such as the size and geometry of the space, how much ventilation is available, the combustion properties of the burning materials and thermal properties of the room surfaces.

Methods for predicting the fire time-temperature conditions have been proposed by researchers in Japan (Kawagoe and Sekine, 1963; and Kawagoe, 1967) and Sweden (Odeen, 1963 and Pettersson, 1984). In predicting the fire performance, two critical parameters are the fire load and the ventilation characteristics of the firecell.

**Fire load:** (Refer definitions on page iv) Fire load density varies greatly with building occupancies. If other factors remain constant, larger fire loads lead to more severe fires in terms of duration. The peak temperatures reached by such fires are governed by the availability of air (ventilation) and the rate of combustion. Thus, an accurate prediction of the possible fire load in a firecell will assist the designer to better estimate the likely fire severity and thus provide adequate and cost-effective fire protection.

**Ventilation:** Heat is produced during the combustion of the firecell contents and other combustible construction. The buoyant hot gases rise and are replaced by cold air drawn in through openings. In most cases the hot gases escape through openings in the upper parts of the enclosure while the cooler replacement air is drawn in through low-level openings. The extent of airflow into the firecell will determine whether the fire is fuel controlled or ventilation controlled. Thus the ventilation available to a fire is dependent on aspects such as the height and width of openings, the height of openings above the floor and whether the vents are open or closed.

Both the fire load and ventilation openings can be expected to vary greatly between various regions of the world due to variations in the culture, climatic conditions and the nature of construction material. Thus the applicability of the work carried out overseas to New Zealand conditions needs to be examined. The purpose of this report is to:

1. Review the methods used in determining fire severity;



2. Develop a procedure/methodology for conducting a fire load survey and analysis of the results;
3. Collect fire load data for life insurance offices in New Zealand; and to review and compare the results with available overseas fire load data.

This report outlines the work carried out in surveying the fire loads and ventilation characteristics for insurance offices in Wellington. Based on the findings, practical design "time-temperature" curves have been developed.


## 2. BACKGROUND

### 2.1 Fire Severity


Fire in any firecell may be divided into three phases: the growth phase, the fully developed phase and the decay phase, as shown in Figure 1. During the growth phase, heat and gas concentrations in the firecell increase as more and more of the fire load becomes involved, until the fire reaches a fully developed stage. Generally, at this stage, if the temperature in the firecell is sufficiently high sudden ignition of the gases and materials in all parts of the firecell will occur (flashover) and the whole firecell will be fully engulfed in flames. Although it may be unlikely in very large firecells that the whole firecell is simultaneously engulfed in fire, post-flashover conditions can occur in parts of the firecell. Nevertheless, the greatest risk to the structure and structural elements depends on the total heat input, ie peak temperatures and duration of heating. Risk of structural failure can also be expected during the decay phase. The study of fire severity is therefore focused on post-flashover conditions, where structural failure may be imminent.

Figure 2 shows the various steps in fire engineering design as described by Pettersson et al (1976) and Pettersson (1984). The starting point in any design must be an assessment of the likely course of a fire that a firecell may be exposed to in its lifetime. Based on the fire severity, the time-temperature field for the structure may be predicted and its structural response determined. If adequate, the structure may be constructed as designed, otherwise changes to the various structural parameters will have to be made to prevent collapse (Wade, 1991).

**Figure 1 : Typical Time-Temperature Curve for Natural Fires in Enclosed Firecells**

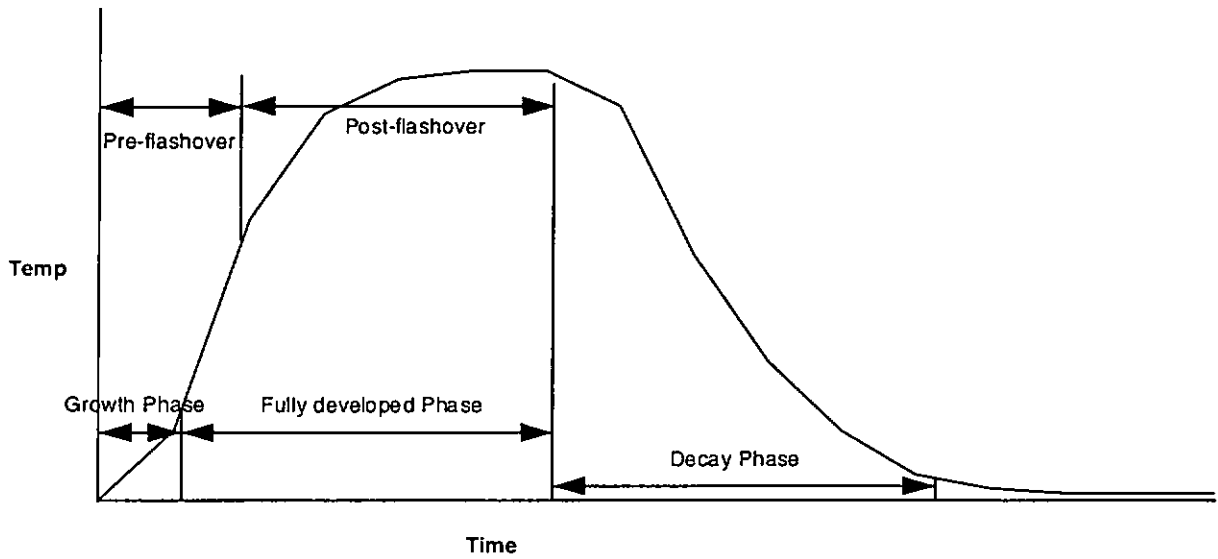

**Figure 2 : Simplified Flow Chart Showing the Steps in Fire Engineering Design**

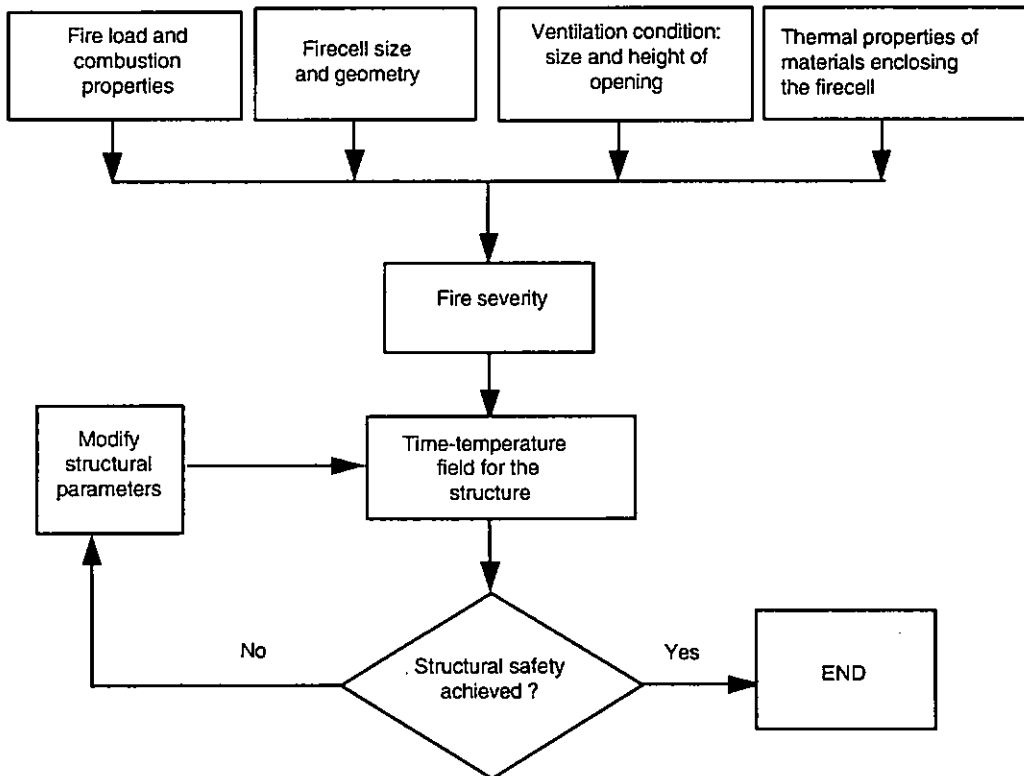

## 2.2 Methods for the Prediction of Fire Severity in Firecells

Fire exposure is estimated by carrying out heat and mass balance calculations. Time-temperature curves for different fire loads have been developed from solving the heat balance equations for enclosed spaces (Kawagoe (1967), Pettersson et al (1976), Lie (1988)). Fires may be either fuel controlled or ventilation controlled depending on the quantity of fuel and air supply available. Kawagoe and Sekine (1963) identified the significance of the fire load density, ventilation to the firecell and the thermal properties of the structure in the heat balance of enclosed spaces. Lie's (1988, 1992) simplification of the expressions developed by Kawagoe and Sekine (1963), Odeen (1963) and Kawagoe (1967) has made them more useable. The prediction methods developed from these studies are based on small firecells.

Odeen's (1963) examination of the heat balance in a firecell for a fully developed fire led to the formulation of the following expression:

$$Q_F + Q_A - Q_G + Q_W + Q_E + Q_R = 0 \quad \text{Equation 1}$$

where:

- $Q_F$  = heat produced by combustion
- $Q_A$  = heat content of the incoming air
- $Q_G$  = heat used in raising ambient gas temperature
- $Q_W$  = heat transfer to walls, floors and ceilings
- $Q_E$  = heat content of exhaust gases
- $Q_R$  = heat loss by radiation from the windows

### 2.2.1 Equivalent Time of Fire Exposure

This concept was presented as a way of relating a compartment fire exposure to the fire severity according to standard fires (ECCS, 1985). The equivalent time of fire exposure is defined as the duration of heating in a standard fire that would give the same critical effect on a structural element exposed to the severity of post-flashover compartment fires. Although this method was first formulated for use with protected structural steel elements, it is also applicable to other building materials. The simplified expression (BSI, 1992) is:

$$t_e = k_b \cdot w_f \cdot e_f \quad \text{Equation 2}$$

where:

- $t_e$  = equivalent time of fire exposure
- $k_b$  = conversion factor as shown in Table 1 below
- $w_f$  = ventilation factor represented by Equation 2a below
- $e_f$  = design fire load density (MJ/m<sup>2</sup> of floor area) based on total fire loads (movable + fixed)

The conversion factor,  $k_b$ , is related to the thermal properties of the enclosure (thermal inertia  $\lambda\rho c$ ), where  $\lambda$  = thermal conductivity (W/mK),  $\rho$  = density (kg/m<sup>3</sup>),  $c$  = specific heat (J/kg K).

**Table 1 : Conversion Factor  $k_b$**

| $\sqrt{(\lambda\rho c)}$ (J/m <sup>2</sup> s <sup>1/2</sup> K) | $k_b$ |
|--|-------|
| $\sqrt{(\lambda\rho c)} > 2500$                                | 0.04  |
| $720 < \sqrt{(\lambda\rho c)} < 2500$                          | 0.055 |
| $\sqrt{(\lambda\rho c)} < 720$                                 | 0.07  |

The ventilation factor  $w_f$  is given by:

$$w_f = \left[ \frac{6.0}{H} \right]^{0.3} \left[ 0.62 + \frac{90(0.4 - \alpha_v)^4}{1 + b_v \alpha_h} \right] > 0.5 \quad \text{Equation 2a}$$

where:

$$\alpha_v = \frac{A_v}{A_f} \quad 0.05 \leq \alpha_v \leq 0.25$$

$$\alpha_h = \frac{A_h}{A_f} \quad \alpha_h \leq 0.20$$

$$b_v = 12.5 (1 + 10\alpha_v - \alpha_v^2) \geq 10.0$$

H = height of the compartment

$A_v$  = total area available for ventilation (in walls)

$A_h$  = total area available for ventilation (in roof)


$A_f$  = total floor area

Design fire loads based on the total fire load available in the firecell are used in this approach.

### 2.2.2. The Swedish Time Temperature Curves

The fire severity predictions of Swedish (Pettersson, 1984) work are also based on solving the heat and mass balances for the firecell. The gas time-temperature curves shown in Figure 3 represent the fire severity in a fully developed compartment fire as a function of fire load density (based on the total mass of combustible material) and the ventilation available for combustion. These design curves are based on the assumption that the bounding material is similar to that of brick or concrete (Pettersson, 1984). They are applicable to typical firecell sizes that would be encountered in the design of dwellings, offices, schools, hospitals, hotels and libraries. It is expected that these design curves may not be suitable for use with large firecells and may provide an inadequate description of the real fire exposure.

Figure 3 : Swedish Temperature-Time Curves For a Fully Developed Compartment Fire

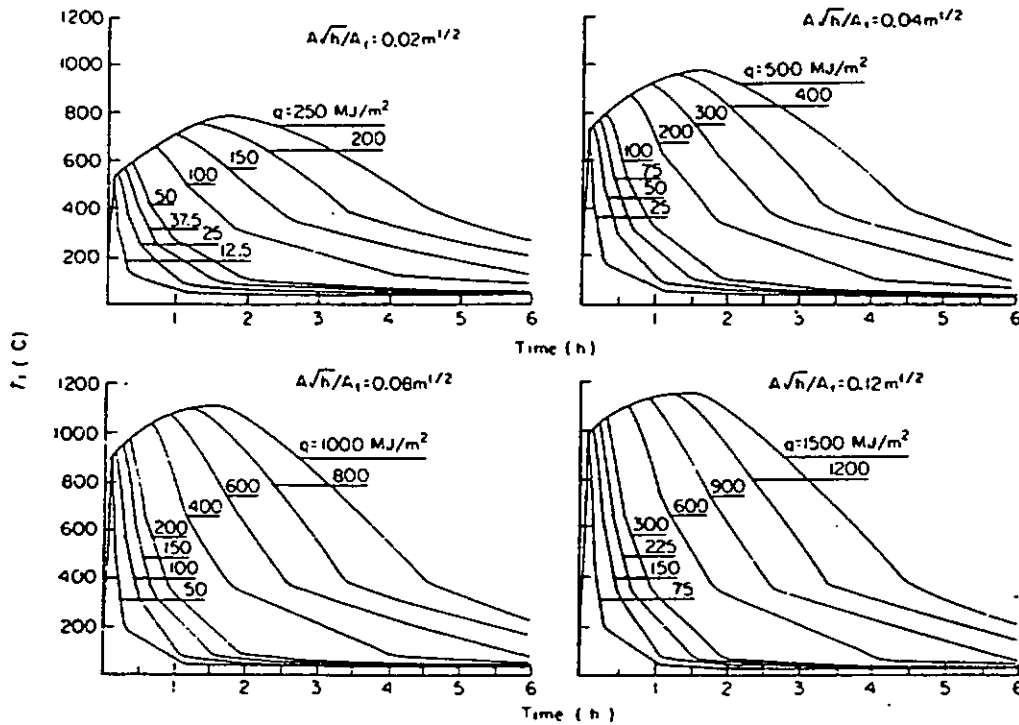

### 2.2.3 Lie's Time-Temperature Curves

To use Lie's expression the fire must be ventilation controlled. Experiments conducted by Harmathy (1972) indicated that fires in firecells with large fire loads (between 800 and 2000 MJ/m<sup>2</sup>) were mainly ventilation controlled. Lie (1992) proposed that time-temperature curves developed on the basis that the fire will be ventilation controlled, have their merits in that ventilation controlled fires are more intense (Harmathy and Mehaffey, 1983). The curves developed on this assumption provide (in the absence of other established methods) a conservative estimate of temperatures for situations where the fire may actually be fuel controlled. Based on this approach, the heat produced by combustion may be directly related to the opening factor,  $K_o$ .

$$K_o = \frac{\sum(A_i \sqrt{H_i})}{A_T} \quad \text{Equation 3}$$

where:

- $A_T$  = total bounding surface (wall, floors and ceiling including openings)
- $A_i$  = the area of the  $i$  th opening in the enclosure
- $H_i$  = the corresponding height of the  $i$  th opening

Kawagoe (1963), in determining the heat release for cellulosic-based products, showed that the rate of burning  $R$  for small firecells, estimated theoretically, could be confirmed using experimental methods.

$$R = 5.5 \times (A_i \sqrt{H_i}) \quad \text{kg / min} \quad \text{Equation 4}$$

or

$$R = 330 \times (A_i \sqrt{H_i}) \quad \text{kg/hr} \quad \text{Equation 5}$$

hence  $\tau$ , the duration of the fire can be expressed as:

$$\tau = \frac{EA_T}{R} = \frac{EA_T}{330 \times (A_i \sqrt{H_i})} \quad \text{Equation 6}$$

or

$$\tau = \frac{E}{330 K_o} \quad \text{Equation 7}$$

where  $E$  = fire load per  $m^2$  of bounding surface.

To simplify the use of Kawagoe's (1967) expression, Lie (1992) selected two sets of material properties as representative of the bounding material:

- one with thermal properties similar to those of high heat capacity and conductivity (or heavy material such as concrete and brick with densities of approximately  $1600 \text{ kg/m}^3$ );
- another representing materials with low heat capacity and conductivity (or light materials such as lightweight concrete and plasterboard with densities of less than  $1600 \text{ kg/m}^3$ ).

Thus, for given thermal properties of the material bounding the enclosure the heat balance as in Equation 1 may be solved for the temperature as a function of the opening factor. This method was used to calculate the gas time-temperature curves for various values of opening factors (Lie, 1988) as follows:

$$T = 250 (10 \times K_o)^{0.1/K_o^{0.3}} e^{-K_o^2 t} [3(1 - e^{-0.6t}) - (1 - e^{3t}) + 4(1 - e^{-12t}) + C \sqrt{600/K_o}] \quad \text{Equation 8}$$

where

$T$  = gas temperature ( $^{\circ}\text{C}$ )

$K_o$  = opening factor ( $\text{m}^{1/2}$ )

$t$  = time from start of fire (hr)

$C$  = 1 for light materials (density  $< 1600 \text{ kg/m}^3$ ),

0 for heavy materials (density  $\geq 1600 \text{ kg/m}^3$ )

This expression is valid only for  $t \leq [\frac{0.08}{K_o} + 1]$ ,

for  $t > [\frac{0.08}{K_o} + 1]$  then  $t = [\frac{0.08}{K_o} + 1]$ .

This expression is again only valid for  $0.01 \leq K_o \leq 0.15$ ,

if  $K_o > 0.15$ , then  $K_o = 0.15$

The various methods of predicting decay of the fire (in terms of temperature drop with time) proposed by Kawagoe (1958), Magnusson and Thelandersson (1970), and Harmathy (1972) are in good agreement in showing that the decay rate is greatly influenced by the duration of the

fully developed stage of the fire. Longer duration of the fully developed stage leads to slower decay rates. Although Lie's (1988) description of the decay process which takes this into account is a conservative approach, the heating effect is unchanged. The decay phase of Lie's (1988) time-temperature curve assumes that decay occurs at a constant rate until it reaches room temperature. The level of fire protection provided, which is based on fully developed conditions, is not affected as a result of this adaptation. The decay phase of Lie's (1988) time-temperature curve is given by:

$$T = - 600 \left( \frac{t}{\tau} - 1 \right) + T_r \quad \text{Equation 9}$$

where

$T_r$  = the gas temperature at which decay begins.


$T = 20^\circ \text{C}$  if  $T < 20^\circ \text{C}$

Thus for  $\tau \geq t$ ,


$$T = \left[ 250 (10 \times F)^{0.1/F^{0.3}} e^{-K_o 2^t} [ 3 (1 - e^{-0.6t}) - (1 - e^{3t}) + 4(1 - e^{-12t}) + C \sqrt{600/K_o} ] - 600 \left( \frac{t}{\tau} - 1 \right) \right] \quad \text{Equation 10}$$

Time-temperature curves based on Lie's expression are shown in Figures 4 and 5. The advantage of Lie's method, is that it can be easily adapted for spreadsheet use by designers who may not have access to more sophisticated computer programs.

**Figure 4 : Time-Temperature Curves for Ventilation Controlled Fires  
(for fire load of 800 MJ/m<sup>2</sup>)**

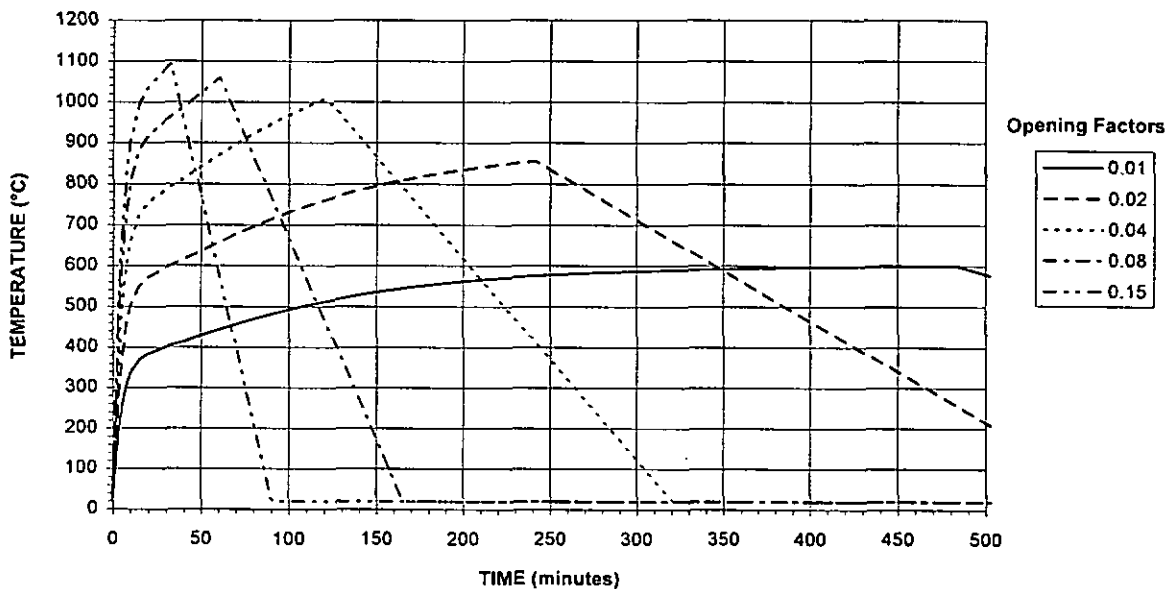

**Figure 5 : Comparison Between Time-Temperature Curves With and Without Decay Phase**

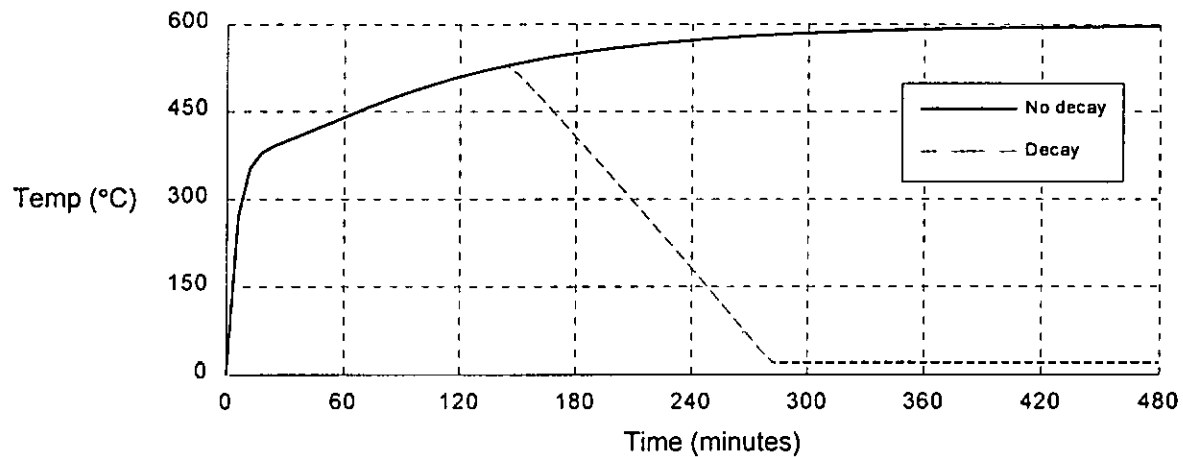

#### 2.2.4 Limitations

**Size of fire cell:** The time-temperature relations used in the three approaches above, based on the solution of heat and mass balances, are applicable to fire compartments of a size representative of residential-type buildings, ordinary offices, schools, hospitals, hotels and libraries (Pettersson, 1984). These methods may not provide satisfactory descriptions of real fire exposure for firecells with very large volumes, such as industrial and sports complexes. All three approaches use unit fire loads based on the total (fixed and movable) fire loads. Data available internationally is generally based on average movable (variable) fire loads. The use of only movable load values in the above approaches could lead to serious underestimation of the design fire loads.

### 2.3 Fire Loads

Dead and live loads within a building may comprise combustible materials that constitute its fire load. In the absence of better data, designers in New Zealand in the past have relied greatly on European fire load information for use in the fire safety design of local buildings. It has not been established whether the fire loads in similar occupancies in Europe reflect accurately the fire loads that may be expected in New Zealand today.

#### 2.3.1 European Fire Load Survey Methodology Applied to New Zealand

A small number of fire load surveys have been carried out in New Zealand by Barnett (1984) as a preliminary study. Barnett's (1984) fire load surveys were conducted for one sample from each of the following occupancies:

- Office
- Hospital
- Warehouse
- Hostel

The fire load surveys carried out in New Zealand as part of this project followed Barnett's (1984) survey procedures.



In estimating fire loads in buildings, the likelihood of the building components and contents participating in the fire must first be assessed. In this regard, the combustion properties of the fire load and their form and location play a critical role. Thus fire loads are categorised on the basis of whether they are fixed (permanent) or movable (variable). It is also important to establish whether the fire loads are in a protected or unprotected state.

### 2.3.2 Estimation of Fire Loads

The following assumptions are made for the estimation of fire loads:

- All combustible material in a firecell would be involved in the fire;
- Combustible materials are uniformly distributed throughout the building;
- Total combustion of all combustible material in the firecell will occur during the fire;
- Rate of burning of non-cellulosics will be the same as for cellulosics and can be directly evaluated on a wood-equivalent basis.

Based on these assumptions, the total fire load may be expressed in one of the three forms described below (Barnett, 1984):

- **Mass:** Fire load measured in terms of mass as represented by Equation 11 has limited use. The use of the mass value directly in calculation will distort results, as the fire load in most cases will be made up of materials with different calorific values.

$$G = [ M_1 + M_2 + \dots + M_n ] \quad \text{Equation 11}$$

where

$G$  = Total fire load in kg

$M_n$  = mass in kg of the individual combustible material in the firecell.

- **Potential Heat Energy:** This method assesses the fire loads as shown in Equation 12. It gives the closest approximation of the total fire load in a firecell. Fire load is estimated on the basis of the calorific values of the individual materials. The difficulty with using this method is that materials have to be assessed individually. The calorific values of the fire loads commonly found in buildings are given in Appendix A.

$$E = [ R_{c1} \times M_1 \times H_{n1} + R_{c2} \times M_2 \times H_{n2} + \dots + R_{cn} \times M_n \times H_{nn} ] \quad \text{Equation 12}$$

where:

$E$  = Total fire load in MJ

$R_c$  = Combined combustion coefficient for the materials in the firecell (discussed later in this section)

$H_n$  = net calorific value of each material at its ambient moisture content (MJ / kg).

- **Mass in Wood Equivalent:** Another commonly used method for expressing fire load is the estimation of fire loads in terms of wood equivalent. This method aims at calculating

the fire load contribution of each item in terms of its stored heat energy and normalising the total fire load using the calorific value for wood.

$$B = \frac{[R_{c1} \times M_1 \times H_{n1} + R_{c2} \times M_2 \times H_{n2} + \dots + R_{cn} \times M_n \times H_{nn}]}{H_w} \quad \text{Equation 13}$$

where:

$B$  = Total fire load in kg  
 $H_w$  = net calorific value of wood at its ambient moisture content (MJ / kg).

### 2.3.3 Fixed or Permanent Fire Loads

Fixed fire loads include all built-in combustible material (CIB W14, 1986) such as doors and frames, walls, partitions, linings, finishings and other permanently installed operation devices such as light fittings, airconditioning ducting, telephones and computers. These often form parts of the firecell that are moved very infrequently during their useful life. Conservative estimates of these loads are recommended to account for changes that may be made during future refurbishment work.

### 2.3.4 Movable or Variable Fire Loads

All fire load which may vary during the life of a building is classed as movable (variable) (CIB W14, 1986). It constitutes items found in buildings such as chairs, tables, filing cabinets, rugs, indoor plants etc. that support combustion. Where a number of variable fire loads with different combustion properties occur which are independent of each other, the improbability of all of them simultaneously attaining high values must be recognised. Allowance is made for incomplete combustion where fuel is protected (eg in a fire-safe cabinet) or is otherwise in a form where it is not expected be consumed 100% in a fire. In such cases a coefficient is applied based on the variability experienced;  $c_q = 0.8$  is considered reasonable in the presence of several independent variable fire loads. For instance, in an office space with wooden tables, plastic plants, wooden shelves, paper files and foam-filled chairs, the variable fire load  $Q_v$  is given by:

$$Q_v = c_q \times [m_{vi} \times H_{vi} + m_{vj} \times H_{vj} + \dots + m_{vn} \times H_{vn}]$$

Equation 14

where:

$E$  = Total variable load in MJ  
 $m_v$  = mass of the variable fire load  
 $H_v$  = calorific value of the combustible material representing the variable fire load.

### 2.3.5 Protected Fire Loads

All combustible material that is less likely to be involved in the fire due to protection provided (to delay their participation in the fire) is known as protected fire load. Consideration of the effects of protection requires an estimate of the likelihood of the failure of the protection. There is presently no established method of assessing the probabilities but the assessment of the probability of failure must include the following steps:

- estimation of the maximum temperature in the firecell
- assessment of the failure probability of the protecting body at this temperature

Surveys carried out (CIB W14, 1986) on protected fire loads have led to two proposals of a combustion coefficient for protection levels,  $c_{pi}$ , based on probability of failure of the protecting body as shown in Table 2. In both cases the relationship between the combustion behaviour and the degree of protection had not been established. Construction of non-combustible protection with failure probabilities of 0.001 or lower will be at huge cost and hence it is unlikely (from the fire load point of view) to be used extensively in a firecell.

**Table 2 : Combination Coefficient for Protected Fire Loads Based on the Probability of Failure**

| Probability of Failure | $c_{pi}$ (a) | $c_{pi}$ (b) |
|------------------------|--------------|--------------|
| 0.100                  | 0.65         | 0.40         |
| 0.010                  | 0.56         | 0.12         |
| 0.001                  | 0.50         | 0.03         |

### 2.3.6 Unprotected Fire load

All fire load that is not protected by non combustible material falls in this sub-category. A conservative estimate will be achieved if it is assumed that all fire loads in the firecell are unprotected ( $c_{pi} = 1$ ).

## 3. FIELD SURVEY - RESULTS AND ANALYSIS

### 3.1 Sample Selection

The primary objective of carrying out fire load surveys in New Zealand was to enable a comparison to be made with fire load values used in Europe. Life office-type occupancies were selected for this study as it was expected that the occupancy load and work activities were relatively similar to those in Europe (CIB W14, 1986). Fire load surveys in 5 life offices in Wellington's central business district were conducted. The following procedures were adapted in the estimation of the fire loads:

1. The first five positive responses from insurance offices, selected at random from the yellow pages of the telephone directory, gave the buildings surveyed.
2. The firecells were selected on the basis of the maximum fire load observed during the preliminary walk through the building.
3. The floor and ventilation areas of the firecell were determined from architectural plans provided by the building owners.
4. Estimation of fire loads was carried out separately as movable and fixed loads (see data collation sheets in Appendix C).

#### 3.1.1 General Observation

All five offices were located in buildings of reinforced concrete frame construction. Except for Sample A3, which had a concrete exterior wall on all sides, all the buildings surveyed had

glazed curtain wall exteriors. The fire load distributions in all were generally similar. There was considerable uniformity in the furniture and fittings found on the floor of any one sample. Due to their rectangular layout all offices showed very similar floor area to total bounding surface area ratios. Tables 3 and 4 show the various aspects for the life offices selected.

**Table 3 : Ventilation Characteristics of Firecells Surveyed**

| Items  | Office Sample No. |         |         |        |        |
|--|-------------------|---------|---------|--------|--------|
|  | A1                | A2      | A3      | A4     | A5     |
| Floor Area in sq. metres, $A_f$              | 477.00            | 1115.57 | 1205.00 | 425.00 | 776.00 |
| Vent Area in $m^2$ , $A_v$                   | 124.14            | 160.40  | 78.20   | 66.08  | 107.60 |
| Total Bounding Surface Area in $m^2$ , $A_t$ | 1163              | 2552    | 2743    | 1048   | 1891   |
| Height of openings in metres, H              | 1.50              | 1.60    | 1.50    | 1.55   | 1.45   |
| Opening Factor, $K_o$                        | 0.13              | 0.08    | 0.03    | 0.08   | 0.07   |

**Table 4 : Building Type and Aspect Ratio Information for Firecells Surveyed**

| Office Sample No: | Building Material | $\frac{A_v}{A_f}$ | $\frac{A_v}{A_t}$ | $\frac{A_f}{A_t}$ | Category (Lie's, 1988) |
|-------------------|-------------------|-------------------|-------------------|-------------------|------------------------|
| A1                | Concrete          | 0.26              | 0.106             | 0.409             | Heavy                  |
| A2                | Concrete          | 0.144             | 0.063             | 0.438             | Heavy                  |
| A3                | Concrete          | 0.065             | 0.028             | 0.438             | Heavy                  |
| A4                | Concrete          | 0.016             | 0.063             | 0.406             | Heavy                  |
| A5                | Concrete          | 0.14              | 0.057             | 0.409             | Heavy                  |

### 3.2 Data Collation

Data was collected under the two main categories: fixed and movable loads.

#### 3.2.1 Fixed Loads

**Electrical and Electronic Equipment:** This category consisted of items such as telephones, computers, facsimile machines, photocopiers and printers. The weight and shape of one unit of each item was assessed and a per unit energy potential was assigned. This value was then used for every unit of the item encountered in the firecell.

**Electrical Wiring:** The total fire load contributed by electrical wiring in the firecell was assessed based on the number of electrical fittings, power points and other electrical connections. The straight line distance between the main switchboard and the approximate centre of the firecell was taken as the average length of wiring per connection.

**Partitions, Walls and Fixtures:** The fire load contributions of partitions were measured on the basis of the volume of combustible material per metre run. The fixtures on walls were assessed for the volume of combustible material.

### 3.2.2 Movable Loads

**Furniture:** In most cases there was great uniformity in the type of furniture found in the firecell. The initial unit was weighed and this value was then used for every unit of the item encountered in the firecell.

**Contents:** The contents of tables, desks, shelves, filing cabinets, cupboards, etc. were weighed initially using scales. Where similarity was encountered the weights were assigned proportionately.

The data collation sheets used in the survey are found in Appendix C. The calorific value used for each item is based on Table 10 (CIB W14, 1986) in Appendix B.

### 3.3 Statistical Analysis of Data

The summary of the potential heat energy (in MJ) values of the fire load (total and average) encountered in the sample offices is shown in Table 5. Figures 6, 7 and 8 represent the normal distribution (Box et al, 1978), based on the mean and standard deviation values for the sample range. Table 6 shows the resulting statistical values for the fixed, movable and total fire load results.


For (well-defined) occupancies with little variation in furniture and contents such as schools, offices, hotels etc. where the coefficient of variation (C.O.V) is between 30 and 50 %, the CIB W14 (1986) method for estimating the 80 and 90 percentile values for the fire load in the building based on the mean is given as:

- 80 percentile value for fire load = ( 1.25 to 1.50) × mean fire load
- 90 percentile value for fire load = ( 1.35 to 1.65) × mean fire load


Table 5 : Fire Loads in Life Offices in Wellington City (Survey Figures)

| Items                        | Office Sample |                           |            |                           |            |                           |            |                           |            |                           |  |  |
|------------------------------|---------------|---------------------------|------------|---------------------------|------------|---------------------------|------------|---------------------------|------------|---------------------------|--|--|
|                              | A1            |                           | A2         |                           | A3         |                           | A4         |                           | A5         |                           |  |  |
| Floor Area (m <sup>2</sup> ) | 477           |                           | 1116       |                           | 1205       |                           | 425        |                           | 776        |                           |  |  |
| Fire Loads:                  | Total (MJ)    | Ave. (MJ/m <sup>2</sup> ) | Total (MJ) | Ave. (MJ/m <sup>2</sup> ) | Total (MJ) | Ave. (MJ/m <sup>2</sup> ) | Total (MJ) | Ave. (MJ/m <sup>2</sup> ) | Total (MJ) | Ave. (MJ/m <sup>2</sup> ) |  |  |
|                              | 63318         | 133                       | 115029     | 103                       | 132778     | 110                       | 47477      | 112                       | 244587     | 315                       |  |  |
| Fixed Load                   |               |                           |            |                           |            |                           |            |                           |            |                           |  |  |
| Movable Load                 |               |                           |            |                           |            |                           |            |                           |            |                           |  |  |
|                              | 74529         | 156                       | 190523     | 171                       | 586337     | 487                       | 212870     | 501                       | 168574     | 217                       |  |  |
| a. Contents                  |               |                           |            |                           |            |                           |            |                           |            |                           |  |  |
| b. Furniture                 | 136379        | 268                       | 169576     | 152                       | 421615     | 350                       | 75229      | 177                       | 105806     | 137                       |  |  |
| Average Movable              | 442           |                           | 323        |                           | 837        |                           | 678        |                           | 354        |                           |  |  |
| Total Fire Load              | 274226        | 575                       | 475128     | 426                       | 1141677    | 947                       | 335576     | 790                       | 519636     | 670                       |  |  |


**Figure 6 : Normal Distribution for Fixed Fire Load in Life Offices**

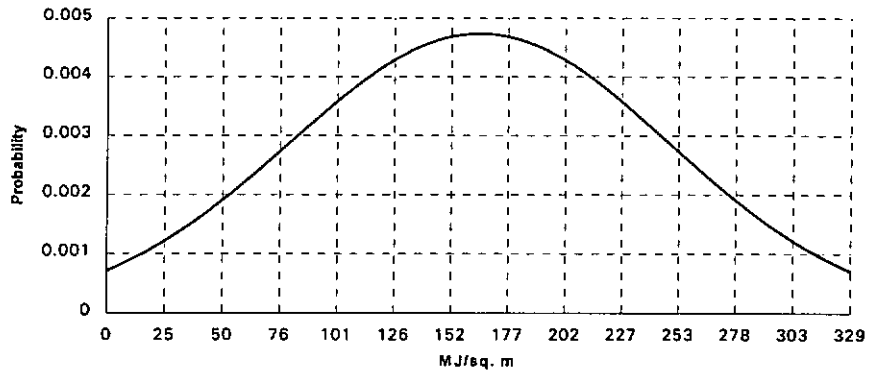

**Figure 7 : Normal Distribution for Movable Fire Load in Life Offices**

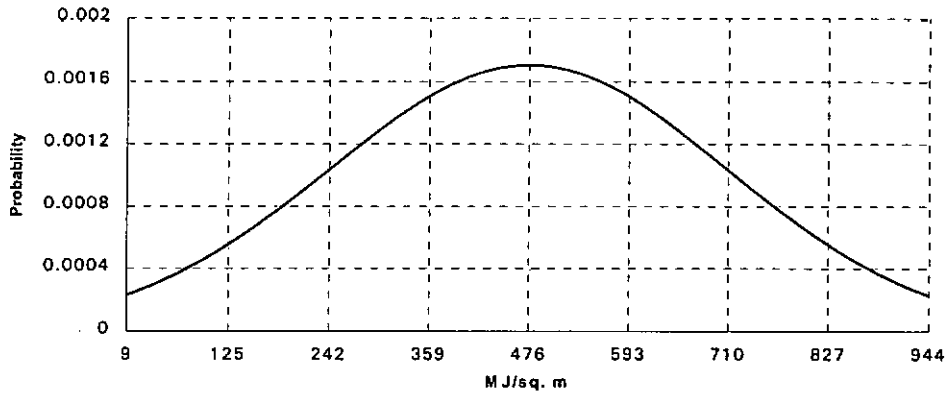

**Figure 8 : Normal Distribution for Total Fire Load in Life Offices**

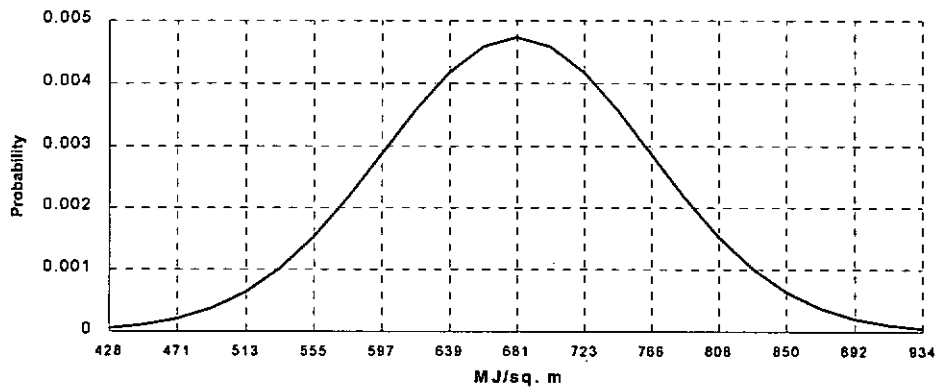

**Table 6 : Results of the Normal Distribution of Fire Loads in New Zealand Life Offices**

| Item   | Statistical Value |                   |                   |                   |                   |                   |
|--|-------------------|-------------------|-------------------|-------------------|-------------------|-------------------|
|  | Fixed Load        |                   | Movable Load      |                   | Total             |                   |
|  | MJ/m <sup>2</sup> | kg/m <sup>2</sup> | MJ/m <sup>2</sup> | kg/m <sup>2</sup> | MJ/m <sup>2</sup> | kg/m <sup>2</sup> |
| Mean, $\bar{x}$  | 164.22            | 9.12              | 476.26            | 26.45             | 681.34            | 37.85             |
| Standard deviation, s                                      | 84.26             | 4.70              | 233.83            | 12.99             | 226.52            | 12.58             |
| 90 percentile value (1.39 $\bar{x}$ )                      |                   |                   |                   |                   | 947.00            | 52.60             |
| 80 percentile value (1.28 $\bar{x}$ )                      | 210.20            | 11.67             | 609.61            | 33.86             | 871.61            | 48.44             |
| Coefficient of variation<br>( $[\bar{x} / s] \times 100$ ) | 51%               |                   | 49%               |                   | 33%               |                   |

**Table 7 : Comparison of New Zealand Life Office Data With Data for Offices From CIB W14 Study**

| Item  | Statistical Values in MJ/m <sup>2</sup> |         |     |       |       |        |
|---|---|---------|-----|-------|-------|--------|
|   | New Zealand                             | Swedish | US  | Swiss | Dutch | French |
| Mean, $\bar{x}$   | 476                                     | 411     | 555 | 750   | 410   | 330    |
| Standard deviation, s                                       | 233                                     | 334     | 625 | -     | 330   | 400    |
| Coefficient of variation<br>( $[\bar{x} / s] \times 100$ )% | 49                                      | 81      | 112 | -     | 80    | 121    |



The values achieved for the various categories in the survey shown in Table 6 compare very well with the CIB W14 (1986) guidelines. The measured c.o.v. is 33% and the 80 and 90 percentile values are 1.28 and 1.39 times the mean total fire load respectively. Table 7 shows the comparison of the mean movable fire loads and c.o.v for office type occupancies in the various countries with the results obtained for New Zealand. Because the sample size for the New Zealand study is small, the small c.o.v. must be taken only as a representative figure. As a representative figure the small c.o.v. confirms the similar layouts of the offices and distribution of the fire loads. The observed difference in the average values may be partly attributed to the natural national differences. Difference in the assessment methods used would also contribute to the variations observed.

Table A1 of NZBC Approved Document C4/AS1 Fire Safety Annex (BIA, 1992) recommends that for a FLED range between 500 - 1000 the design value (or the 80 percentile value of FLED) be taken as 800 MJ/m<sup>2</sup> and is categorised under FHC (Fire Hazard Category) 2. The measured 80 percentile value for total fire loads shows 9% variation from the recommended design value (BIA, 1992). This is a good comparison but is only applicable to FLED values whose mean and standard deviation are as shown in Table 6. Average FLED values closer to the maximum value of the category (in this case closer to 1000 MJ/m<sup>2</sup> for FHC 2) may be expected to be much greater than the recommended design values in C4/AS1 Fire Safety Annex.

The general arrangement and distribution of fire loads in a firecell has a significant influence on the amount of fire load that will become involved in the combustion process. Thus, to take this aspect into account and to make a closer approximation of design values, the design FLED may be based on the following expression:

$$\text{Design value for fire load} = F_d \times K_d \times \text{mean fire load}$$

$F_d$  = Factor for the distribution characteristics of fire loads.

$K_d$  = Factors applied to the mean fire load to obtain the 80 and 90 percentile values to be used in design

The value for  $F_d$  and  $K_d$  are given in Table 8 below.

**Table 8 :  $F_d$  and  $K_d$  Values for Fire Loads (CIB W14, 1986)**

| Precision of Design Value | Fire Load Distribution Factors |                                    | $K_d$ Values |
|---------------------------|--------------------------------|------------------------------------|--------------|
|                           | Uniform Distribution ( $F_d$ ) | Non-Uniform Distribution ( $F_d$ ) |              |
| 90 percentile             | 1.00                           | 1.20                               | 1.35 - 1.65  |
| 80 percentile             | 1.00                           | 1.15                               | 1.25 - 1.50  |


### 3.4 Engineering Analysis of Data

To illustrate the usefulness of the fire load data collected, the fire load values were input into Lie's time-temperature expression. The result for the various samples is shown in Figure 9. Comparisons of the maximum temperatures and the time at which they occurred from the plots with values from the Swedish plots are given in Table 9. The maximum temperatures show good comparison within 15%. Lie's shorter times for the maximum temperature implies a shorter growth phase.


The pinched time-temperature curves are observed for all samples except sample A3. Both Lie's (1988) and Pettersson et al's (1976) curves show quicker fire growth and shorter fire duration for fire in firecells with larger opening factors. This feature results from the assumption that all openings covered over with glazing are available for ventilation. Sample A3 has a concrete exterior wall with windows, unlike the other samples which have glazed curtain wall exteriors. This is illustrated in Figure 10 where the fire loads for sample A3 are plotted against various ventilation factors.

The 80 percentile values of the fire loads have been used to develop time-temperature curves as shown in Figure 10. The curves demonstrate that for very low opening factors the fire would be ventilation controlled and cooler. Thus, using low opening factors in the design of buildings will affect the duration of fire, and therefore the design of structural members in that building.

**Figure 9 : Lie (1988) Time-Temperature Curves for Average Fire Load Values for Samples A1-A5**

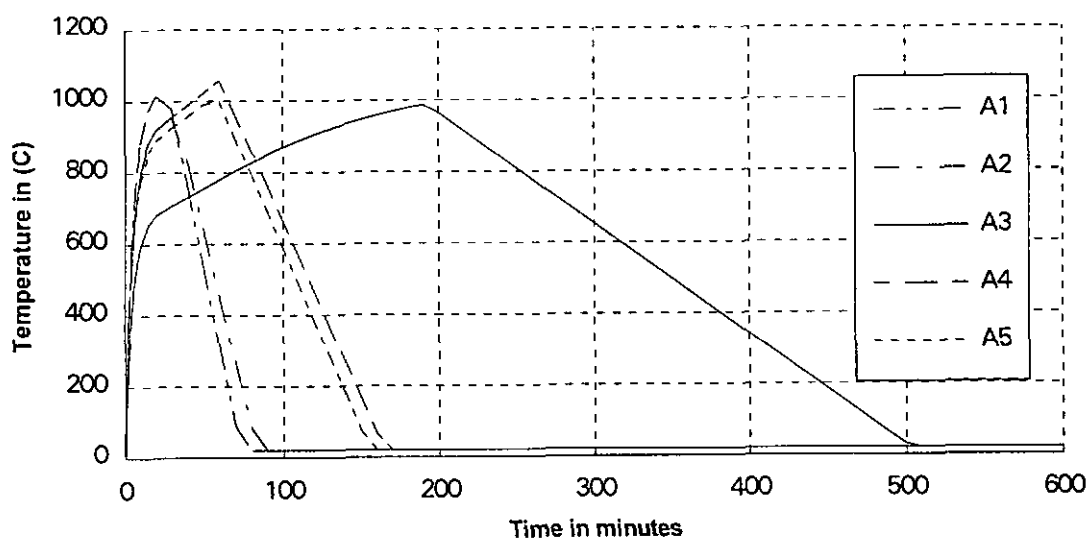

**Figure 10 : Lie's Time-Temperature Curves for Sample A3 (Assuming Various Opening Factors)**

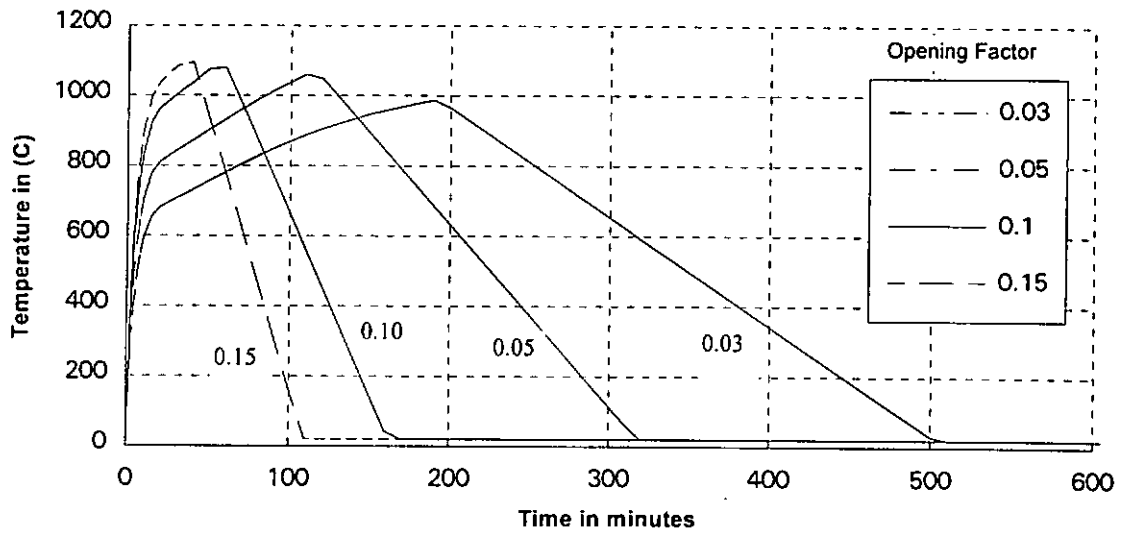

**Table 9 : Comparison of the Time-Temperature Results from Lie's Plot with the Swedish Curves**

| Sample Nos. | Maximum temp<br>in °C |                     | Time of Occurrence<br>in hrs |                     |
|-------------|-----------------------|---------------------|------------------------------|---------------------|
|             | Lie (1988)            | Petterson<br>(1984) | Lie (1988)                   | Petterson<br>(1984) |
| A1*         | 1020                  | 1130                | 0.30                         | 0.70                |
| A2          | 920                   | 1050                | 0.40                         | 0.65                |
| A3*         | 980                   | 1030                | 2.01                         | 2.40                |
| A4          | 1060                  | 1135                | 0.70                         | 1.20                |
| A5*         | 1005                  | 1080                | 0.65                         | 0.80                |

\* The Swedish values (Petterson) are obtained by interpolation of the time-temperature curves

## 4. CONCLUSIONS AND RECOMMENDATIONS

### 4.1 Conclusions

**Sampling:** The survey method has proven to be an effective means of determining the total fire load in buildings. In comparing the results with results available internationally, attention must be paid by the user to the influence of:

- × the natural national differences and assessment methods to the variation in fire loads, and
- × the smallness of the sample size for the survey carried out in New Zealand.

**Time-temperature curves:** An accurate prediction of the time-temperature curve is critical in the use of design for structural safety. The floor area to the total bounding surface area ratio for each of the offices surveyed represents a large firecell scenario. Thus the time-temperature predictions in this report, based on energy and mass conservation for small firecells, although only representative, are conservative figures. The stability and approximations of Lie's time-temperature curves using the fire loads from the survey have been compared with results from the Swedish plots. Good comparisons were observed.

**Fire loads:** The fire load estimates for life offices in New Zealand compare reasonably well with those from other countries. The significant difference is in the degree of variation between offices. The variation experienced in New Zealand is considerably less than that in other nations (due to the small sample).

Two aspects of concern were encountered during the course of this study with respect to the use of the European values for fire loads (CIB W14, 1986) in New Zealand:

- The values from Table A1.3.13 (CIB W14, 1986) are based on average variable loads only. The concern is that these values are being used in calculations where total fire loads are required i.e. the fixed fire load should be included as well.
- From the comparison of the average variable load for business offices from Table A1.3.13 with the average variable fire loads for life offices in New Zealand, it is believed that there could be an over-estimation of fire loads if the values from Table A1.3.13 are used for design of office buildings in New Zealand.

### 4.2 Recommendations

On the basis of the findings of this study a recommendation is made for additional fire load surveys to be conducted to achieve the following:

- × to update the generally obsolete overseas data;
- × for comparison of the results for other occupancies with the CIB W14 data (CIB W14, 1986) to establish if there is a trend in the variation in the fire loads encountered when compared with international results;
- × to establish the fire loads for occupancies specific to New Zealand, such as storage of agricultural commodities, which are not available internationally.

## 5. REFERENCES

- Babrauskas, V. 1979. COMPF2 : A Program for Calculating Post-Flashover Fire Temperatures. Centre for Fire Research, National Engineering Laboratory. National Bureau of Standards. Washington D.C.
- Barnett, C.R. 1984. Pilot Fire Load Survey carried out for the New Zealand Fire Protection Association. MacDonald Barnett Partners, Auckland.
- Barnett, C.R., Buchanan, A.H. and Butcher, G.W. 1987. Seminar on the Draft Design Code. Department of Continuing Education. University of Canterbury.
- Box, G.E.P., Hunter, W.G., and Hunter J.S. 1978. Statistics for Experimenters. An Introduction to Design, Data Analysis and Model Building. John Wiley and Sons. USA.
- British Standards Institution (BSI). 1992. Eurocode 1 : Part 10 Actions on Structures Exposed to Fire : Part 10A General Principles and Nominal Thermal Actions. London.
- Building Industry Authority (BIA). 1992. Approved Document C4/AS1 Fire Safety Annex. Published by Standards New Zealand, Wellington.
- CIB W14. 1986. Design Guide - Structural Fire Safety. Report of CIB W14 Workshop. Fire Safety Journal Vol 10, No. 2. pp 77-137.
- European Convention for Constructional Steelwork (ECCS). 1985. Design Manual on the European Recommendations for the Fire Safety of Steel Structures. No 35, First Edition. Brussels.
- Harmathy, T.Z. 1972. A New Look at Compartment Fires. Part 1 and Part 2. Fire Technology.
- Harmathy, T.Z. and Mehaffey, J.R. 1983. Post-flashover Compartment Fires. Review Paper. Fire and Materials, Vol 7, No. 2.
- Kawagoe, K. 1967. Estimation of Fire Temperature-Time Curves in Rooms. Research Report No. 29. Building Research Institute, Ministry of Construction, Tokyo. Japan.
- Kawagoe, K. and Sekine, T. 1963. Estimation of Fire Temperature-Time Curves in Rooms. B.R.I. Occasional Report No. 11. Building Research Institute, Ministry of Construction, Tokyo. Japan.
- Lie, T.T. 1972. Fire and Buildings. Applied Science Publishers Limited. London.
- Lie, T.T. 1988. Fire Temperature Relations. In the SFPE Handbook of Fire Protection Engineering. National Fire Protection Association. U.S.A.
- Lie, T.T. 1992 (editor). Structural Fire Protection. ASCE Manuals and Reports on Engineering Practice No. 78. Prepared by the Committee of Fire Protection, Structural Division, American Society of Civil Engineers. New York. USA.
- Odeen K. 1963. Theoretical Study of Fire Characteristics in Enclosed Spaces. Bulletin 10, Division of Building Construction, Royal Institute of Technology. Stockholm, Sweden.

Pettersson, O. 1984. Requirements of Fire Resistance Based on Actual Fires (Swedish Approach). Division of Building Fire Safety and Technology. Lund Institute of Technology. Lund. Sweden.

Pettersson, O., Magnusson S., Thor, J. 1976. Fire Engineering Design of Steel Structures. Division of Structural Mechanics and Concrete Construction. Lund University of Technology. Lund. Sweden.

Standards Australia (SA). 1990. AS 1530 Part 4: Fire Resistance Tests of Elements of Building Construction.

Wade, C.A. 1991. Fire Engineering Design of Reinforced and Prestressed Concrete Elements. Building Research Association of New Zealand. BRANZ Study Report No. 33. Judgeford, New Zealand.

**APPENDIX A**

## Fixed Fire Loads from CIB W14 (1986)

| Type of Occupancies                     | Fabrication<br>(MJ/m <sup>2</sup> ) | Storage |
|---|-------------------------------------|---------|
| <b>Academy</b>                          | 300                                 |         |
| Accumulator forwarding                  | 800                                 |         |
| Accumulator mfg                         | 400                                 | 800     |
| Acetylene cylinder storage              | 700                                 |         |
| Acid plant                              | 80                                  |         |
| Adhesive mfg                            | 1000                                | 3400    |
| Administration                          | 800                                 |         |
| Adsorbent plant for combustible vapours | >1700                               |         |
| Aircraft hangar                         | 200                                 |         |
| Airplane factory                        | 200                                 |         |
| Aluminium mfg                           | 40                                  |         |
| Aluminium processing                    | 200                                 |         |
| Ammunition mfg                          | Spez                                |         |
| Animal food preparing, mfg              | 2000                                | 3300    |
| Antique shop                            | 700                                 |         |
| Apparatus forwarding                    | 700                                 |         |
| Apparatus mfg                           | 400                                 |         |
| Apparatus repair                        | 600                                 |         |
| Apparatus testing                       | 200                                 |         |
| Arms mfg                                | 300                                 |         |
| Arms sales                              | 300                                 |         |
| Artificial flower mfg                   | 300                                 | 200     |
| Artificial leather mfg                  | 1000                                | 1700    |
| Artificial leather processing           | 300                                 |         |
| Artificial silk mfg                     | 300                                 | 1100    |
| Artificial silk processing              | 210                                 |         |
| Artificial stone mfg                    | 40                                  |         |
| Asylum                                  | 400                                 |         |
| Authority office                        | 800                                 |         |
| Awning mfg                              | 300                                 | 1000    |
| <b>Bag mfg (jute, paper, plastic)</b>   | 500                                 |         |
| Bakery                                  | 200                                 |         |
| Bakery, sales                           | 300                                 |         |
| Ball bearing mfg                        | 200                                 |         |
| Bandage mfg                             | 400                                 |         |
| Bank, counters                          | 300                                 |         |
| Bank, offices                           | 800                                 |         |
| Barrel mfg, wood                        | 1000                                | 800     |
| Basement, dwellings                     | 900                                 |         |
| Basketwear mfg                          | 300                                 | 200     |
| Bed sheeting production                 | 500                                 | 1000    |
| Bedding plant                           | 600                                 |         |
| Bedding shop                            | 500                                 |         |
| Beer mfg (brewery)                      | 80                                  |         |
| Beverage mfg, non alcoholic             | 80                                  |         |
| Bicycle assembly                        | 200                                 | 400     |
| Biscuit factories                       | 200                                 |         |
| Biscuit mfg                             | 200                                 |         |
| Bitumen preparation                     | 800                                 | 3400    |
| Blind mfg, venetian                     | 800                                 | 300     |
| Blueprinting firm                       | 400                                 |         |
| Boarding school                         | 300                                 |         |
| Boat mfg                                | 600                                 |         |
| Boiler house                            | 200                                 |         |
| Bookbinding                             | 1000                                |         |
| Bookstore                               | 1000                                |         |
| Box mfg                                 | 1000                                | 600     |
| Brick plant, burning                    | 40                                  |         |
| Brick plant, clay preparation           | 40                                  |         |

| Type of Occupancies                            | Fabrication<br>(MJ/m <sup>2</sup> ) | Storage |
|--|-------------------------------------|---------|
| Brick plant, drying kiln with wooden grates    | 1000                                |         |
| Brick plant, drying room with metal grates     | 40                                  |         |
| Brick plant, drying room with wooden grates    | 400                                 |         |
| Brick plant, pressing                          | 200                                 |         |
| Briquette factories                            | 1600                                |         |
| Broom mfg                                      | 700                                 | 400     |
| Brush mfg                                      | 700                                 | 800     |
| Butter mfg                                     | 700                                 | 4000    |
| <b>Cabinet making (without woodyard)</b>       | 600                                 |         |
| Cable mfg                                      | 300                                 | 600     |
| Cafe   |                                     | 400     |
| Camera mfg                                     | 300                                 |         |
| Candle mfg                                     | 1300                                | 22400   |
| Candy mfg                                      | 400                                 | 1500    |
| Candy packing                                  | 800                                 |         |
| Candy shop                                     | 400                                 |         |
| Cane products mfg                              | 400                                 | 200     |
| Canteen  | 300                                 |         |
| Car accessory sales                            | 300                                 |         |
| Car assembly plant                             | 300                                 |         |
| Car body repairing                             | 150                                 |         |
| Car paint shop                                 | 500                                 |         |
| Car seat cover shop                            | 700                                 |         |
| Cardboard box mfg                              | 800                                 | 2500    |
| Cardboard mfg                                  | 300                                 | 4200    |
| Cardboard products mfg                         | 800                                 | 2500    |
| Carpenter shed                                 | 700                                 |         |
| Carpet dyeing                                  | 500                                 |         |
| Carpet mfg                                     | 600                                 | 1700    |
| Carpet store                                   | 800                                 |         |
| Cartwright's shop                              | 500                                 |         |
| Cast iron foundry                              | 400                                 | 800     |
| Celluloid mfg                                  | 800                                 | 3400    |
| Cement mfg                                     | 1000                                |         |
| Cement plant                                   | 40                                  |         |
| Cement products mfg                            | 80                                  |         |
| Cheese factory                                 | 120                                 |         |
| Cheese mfg (in boxes)                          | 170                                 |         |
| Cheese store                                   | 100                                 |         |
| Chemical plants (rough average)                | 300                                 | 1000    |
| Chemist's shop                                 | 1000                                |         |
| Children's home                                | 400                                 |         |
| China mfg                                      | 200                                 |         |
| Chipboard finishing                            | 800                                 |         |
| Chipboard pressing                             | 100                                 |         |
| <i>Chocolate factory, intermediate storage</i> | 6000                                |         |
| Chocolate factory, packing                     | 500                                 |         |
| Chocolate factory, tumbling treatment          | 1000                                |         |
| Chocolate factory, all other specialities      | 500                                 |         |
| Church   | 200                                 |         |
| Cider mfg (without crate storage)              | 200                                 |         |
| Cigarette plant                                | 300                                 |         |
| Cinema   | 300                                 |         |
| Clay, preparing                                | 50                                  |         |
| Cloakroom, metal wardrobe                      | 80                                  |         |
| Cloakroom, wooden wardrobe                     | 400                                 |         |
| Cloth mfg                                      | 400                                 |         |
| Clothing plant                                 | 500                                 |         |
| Clothing store                                 | 600                                 |         |
| Coal bunker                                    | 2500                                |         |



| Type of Occupancies                             | Fabrication<br>(MJ/m <sup>2</sup> ) | Storage |
|---|-------------------------------------|---------|
| Coal cellar                                     |                                     | 10500   |
| Cocoa processing                                | 800                                 |         |
| Coffee-extract mfg                              | 300                                 |         |
| Coffee roasting                                 | 400                                 |         |
| Cold storage                                    | 2000                                |         |
| Composing room                                  | 400                                 |         |
| Concrete products mfg                           | 100                                 |         |
| Condiment mfg                                   | 50                                  |         |
| Congress hall                                   | 600                                 |         |
| Contractors                                     |                                     | 500     |
| Cooking-stove mfg                               | 600                                 |         |
| Coopering                                       | 600                                 |         |
| Cordage plant                                   | 300                                 | 600     |
| Cordage store                                   | 500                                 |         |
| Cork products mfg                               | 500                                 | 800     |
| Cosmetics mfg                                   | 300                                 | 500     |
| Cotton mills                                    | 1200                                |         |
| Cotton wool mfg                                 | 300                                 |         |
| Cover mfg                                       | 500                                 |         |
| Cutlery mfg (household)                         | 200                                 |         |
| Cutting-up shop, leather, artificial leather    | 300                                 |         |
| Cutting-up shop, textiles                       | 500                                 |         |
| Cutting-up shop, wood                           | 700                                 |         |
| <b>Dairy</b>                                    | 200                                 |         |
| Data processing                                 | 400                                 |         |
| Decoration studio                               | 1200                                | 2000    |
| Dental surgeons laboratory                      | 300                                 |         |
| Dentist's office                                | 200                                 |         |
| Department store                                | 400                                 |         |
| Distilling plant, combustible materials         | 200                                 |         |
| Distilling plant, incombustible materials       | 50                                  |         |
| Doctor's office                                 | 200                                 |         |
| Door mfg, wood                                  | 800                                 | 1800    |
| Dressing, textiles                              | 200                                 |         |
| Dressing, paper                                 | 700                                 |         |
| Dressmaking shop                                | 300                                 |         |
| Dry-cell battery                                | 400                                 | 600     |
| Dry cleaning                                    | 300                                 |         |
| Dyeing plant                                    | 500                                 |         |
| <b>Edible fat forwarding</b>                    | 900                                 |         |
| Edible fat mfg                                  | 1000                                | 18900   |
| Electric appliance mfg                          | 400                                 |         |
| Electric appliance repair                       | 500                                 |         |
| Electric motor mfg                              | 300                                 |         |
| Electrical repair shop                          | 600                                 |         |
| Electrical supply storage H < 3 m               | 1200                                |         |
| Electro Industry                                | 600                                 |         |
| Electronic device mfg                           | 400                                 |         |
| Electronic device repair                        | 500                                 |         |
| Embroidery                                      | 300                                 |         |
| Etching plant glass/metal                       | 200                                 |         |
| Exhibition hall, cars including decoration      | 200                                 |         |
| Exhibition hall, furniture including decoration | 500                                 |         |
| Exhibition hall, machines including decoration  | 80                                  |         |
| Exhibition of paintings including decoration    | 200                                 |         |
| Explosive Industry                              | 4000                                |         |

| Type of Occupancies  | Fabrication<br>(MJ/m <sup>2</sup> ) | Storage |
|--|-------------------------------------|---------|
| <b>Fertiliser mfg</b>  | 200                                 | 200     |
| Filling plant/barrels  |                                     |         |
| liquid filled and/or barrels incombustible                     | <200                                |         |
| liquid filled and/or barrels combustible:                      |                                     |         |
| Risk Class I   | >3400                               |         |
| Risk Class II  | >3400                               |         |
| Risk Class III   | >3400                               |         |
| Risk Class IV  | >3400                               |         |
| Risk Class V   | >1700                               |         |
| (if higher, take into consideration combustibility of barrels) |                                     |         |
| Filling plant, small casks                                     |                                     |         |
| liquid filled and casks  | <200                                |         |
| incombustible liquid filled and/or casks combustible:          |                                     |         |
| Risk Class I   | <500                                |         |
| Risk Class II  | <500                                |         |
| Risk Class III   | <500                                |         |
| Risk Class IV  | <500                                |         |
| Risk Class V   | <500                                |         |
| (if higher, take into consideration combustibility of casks)   |                                     |         |
| Finishing plant, paper   | 500                                 |         |
| Finishing plant, textile                                       | 300                                 |         |
| Fire works mfg   | Spez                                | 2000    |
| Flat   |                                     | 300     |
| Floor covering mfg   | 500                                 | 6000    |
| Floor covering store   | 1000                                |         |
| Flooring plaster mfg   | 600                                 |         |
| Flour products   | 800                                 |         |
| Flower sales   | 80                                  |         |
| Fluorescent tube mfg   | 300                                 |         |
| Foamed plastics fabrication                                    | 3000                                | 2500    |
| Foamed plastics processing                                     | 600                                 | 800     |
| Food forwarding  | 1000                                |         |
| Food store   | 700                                 |         |
| Forge  |                                     | 80      |
| Forwarding, appliances partly made of plastic                  | 700                                 |         |
| Forwarding, beverage   | 300                                 |         |
| Forwarding, cardboard goods                                    | 600                                 |         |
| Forwarding, food   | 1000                                |         |
| Forwarding, furniture  | 600                                 |         |
| Forwarding, glassware  | 700                                 |         |
| Forwarding, plastic products                                   | 1000                                |         |
| Forwarding, printed matters                                    | 1700                                |         |
| Forwarding, textiles   | 600                                 |         |
| Forwarding, tinware  | 200                                 |         |
| Forwarding, varnish, polish                                    | 1300                                |         |
| Forwarding, woodware small)                                    | 600                                 |         |
| Foundry (metal)  | 40                                  |         |
| Fur, sewing  | 400                                 |         |
| Fur store  | 200                                 |         |
| Furniture exhibition   | 500                                 |         |
| Furniture mfg (wood)   | 600                                 |         |
| Furniture polishing  | 500                                 |         |
| Furniture store  | 400                                 |         |
| Furrier  | 500                                 |         |
| <b>Galvanic station</b>  | 200                                 |         |
| Gambling place   | 150                                 |         |

| Type of Occupancies                         | Fabrication<br>(MJ/m <sup>2</sup> ) | Storage |
|---|-------------------------------------|---------|
| Glass blowing plant                         | 200                                 |         |
| Glass factory                               | 100                                 |         |
| Glass mfg                                   | 100                                 |         |
| Glass painting                              | 300                                 |         |
| Glass processing                            | 200                                 |         |
| Glassware mfg                               | 200                                 |         |
| Glassware store                             | 200                                 |         |
| Glazier's workshop                          | 700                                 |         |
| Gold plating (of metals)                    | 800                                 | 3400    |
| Goldsmith's workshop                        | 200                                 |         |
| Grainmill, without storage                  | 400                                 | 13000   |
| Gravestone carving                          | 50                                  |         |
| Graphic workshop                            | 1000                                |         |
| Greengrocer's shop                          | 200                                 |         |
| <b>H</b> airdressing shop                   | 300                                 |         |
| Hardening plant                             | 400                                 |         |
| Hardware mfg                                | 200                                 |         |
| Hardware store                              | 300                                 |         |
| Hat mfg                                     | 500                                 |         |
| Hat store                                   | 500                                 |         |
| Heating equipment room, wood or coal firing | 300                                 |         |
| Heat sealing of plastics                    | 800                                 |         |
| High-rise office building                   | 800                                 |         |
| Homes                                       | 500                                 |         |
| Homes for aged                              | 400                                 |         |
| Hosiery mfg                                 | 300                                 | 1000    |
| Hospital                                    | 300                                 |         |
| Hotel                                       | 300                                 |         |
| Household appliance, mfg                    | 300                                 | 200     |
| Household appliance, sales                  | 300                                 |         |
| <b>I</b> ce cream (including packaging)     | 100                                 |         |
| Incandescent lamp plant                     | 40                                  |         |
| Injection moulded parts mfg (metal)         | 80                                  |         |
| Injection moulded parts mfg (plastic)       | 500                                 |         |
| Institution building                        | 500                                 |         |
| Ironing                                     | 500                                 |         |
| <b>J</b> ewellery mfg                       | 200                                 |         |
| Jewellery shop                              | 300                                 |         |
| Joinery                                     | 700                                 |         |
| Joiners (machine room)                      | 500                                 |         |
| Joiners (workbench)                         | 700                                 |         |
| Jute, weaving                               | 400                                 | 1300    |
| <b>L</b> aboratory, bacteriological         | 200                                 |         |
| Laboratory, chemical                        | 500                                 |         |
| Laboratory, electric, electronic            | 200                                 |         |
| Laboratory, metallurgical                   | 200                                 |         |
| Laboratory, physics                         | 200                                 |         |
| Lacquer forwarding                          | 1000                                |         |
| Lacquer mfg                                 | 500                                 | 2500    |
| Large metal constructions                   | 80                                  |         |
| Lathe shop                                  | 600                                 |         |
| Laundry                                     | 200                                 |         |
| Leather goods sales                         | 700                                 |         |
| Leather product mfg                         | 500                                 |         |
| Leather, tanning, dressing, etc             | 400                                 |         |
| Library                                     | 2000                                | 2000    |

| Type of Occupancies                          | Fabrication<br>(MJ/m <sup>2</sup> ) | Storage |
|--|-------------------------------------|---------|
| Lingerie mfg                                 | 400                                 |         |
| Liqueur mfg                                  | 400                                 |         |
| Liquor mfg                                   | 400                                 | 800     |
| Liquor store                                 | 700                                 |         |
| Loading ramp including goods (rough average) | 800                                 |         |
| Lumber room for miscellaneous goods          | 500                                 |         |
| <b>M</b> achinery mfg                        | 200                                 |         |
| Match plant                                  | 300                                 | 800     |
| Mattress mfg                                 | 500                                 | 500     |
| Meat shop                                    | 50                                  |         |
| Mechanical workshop                          | 200                                 |         |
| Metal goods mfg                              | 200                                 |         |
| Metal grinding                               | 80                                  |         |
| Metal working (general)                      | 200                                 |         |
| Milk, condensed, evaporated, mfg             | 200                                 | 9000    |
| Milk, powdered, mfg                          | 200                                 | 10500   |
| Milling work, metal                          | 200                                 |         |
| Mirror mfg                                   | 100                                 |         |
| Motion-picture studio                        | 300                                 |         |
| Motor cycle assembly                         | 300                                 |         |
| Museum                                       | 300                                 |         |
| Musical instruction sales                    | 281                                 |         |
| <b>N</b> ews-stand                           | 1300                                |         |
| Nitrocellulose mfg                           | Spez                                | 1100    |
| Nuclear research                             | 2100                                |         |
| Nursery school                               | 300                                 |         |
| <b>O</b> ffice, business                     | 800                                 |         |
| Office, engineering                          | 600                                 |         |
| Office furniture                             | 700                                 |         |
| Office, machinery mfg                        | 300                                 |         |
| Office machine sales                         | 300                                 |         |
| Oilcloth mfg                                 | 700                                 | 1300    |
| Oilcloth processing                          | 700                                 | 2100    |
| Optical instrument mfg                       | 200                                 | 200     |
| <b>P</b> acking, food                        | 800                                 |         |
| Packing, incombustible goods                 | 400                                 |         |
| Packing material industry                    | 1600                                | 3000    |
| Packing, printed matters                     | 1700                                |         |
| Packing, textiles                            | 600                                 |         |
| Packing, all other combustible goods         | 600                                 |         |
| Paint and varnish, mfg                       | 4200                                |         |
| Paint and varnish, mixing plant              | 2000                                |         |
| Paint and varnish shop                       | 1000                                |         |
| Paint shop (cards, machines, etc)            | 200                                 |         |
| Paint shop (furniture etc)                   | 400                                 |         |
| Paper mfg                                    | 200                                 | 10000   |
| Paper processing                             | 800                                 | 1100    |
| Parking building                             | 200                                 |         |
| Parquetry mfg                                | 2000                                | 1200    |
| Perambulator mfg                             | 300                                 | 800     |
| Perambulator shop                            | 300                                 |         |
| Perfume sale                                 | 500                                 |         |
| Pharmaceuticals, packing                     | 300                                 | 800     |
| Pharmaceutical mfg                           | 300                                 | 800     |
| Pharmacy (including storage)                 | 800                                 |         |

| Type of Occupancies                                  | Fabrication<br>(MJ/m <sup>2</sup> ) | Storage |
|--|-------------------------------------|---------|
| Photographic laboratory                              | 100                                 |         |
| Photographic store                                   | 300                                 |         |
| Photographic studio                                  | 300                                 |         |
| Picture frame mfg                                    | 300                                 |         |
| Plaster product mfg                                  | 80                                  |         |
| Plastic floor tile mfg                               | 800                                 |         |
| Plastic mfg  | 2000                                | 5900    |
| Plastic processing                                   | 600                                 |         |
| Plastic products fabrication                         | 600                                 |         |
| Plumber's workshop                                   | 100                                 |         |
| Plywood mfg  | 800                                 | 2900    |
| Polish mfg   | 1700                                |         |
| Post office  | 400                                 |         |
| Potato, flaked, mfg                                  | 200                                 |         |
| Pottery plant  | 200                                 |         |
| Power station  | 600                                 |         |
| Precious stone, cutting etc                          | 80                                  |         |
| Precision instrument mfg<br>containing plastic parts | 200                                 |         |
| without plastic parts                                | 100                                 |         |
| Precision mechanics plant                            | 200                                 |         |
| Pressing, metal                                      | 100                                 |         |
| Pressing, plastics, leather etc                      | 400                                 |         |
| Preparation briquette production                     |                                     |         |
| Printing, composing room                             | 300                                 |         |
| Printing ink mfg                                     | 700                                 | 3000    |
| Printing, machine hall                               | 400                                 |         |
| Printing office                                      | 1000                                |         |
| <b>R</b> adio and TV mfg                             | 400                                 |         |
| Radio and TV sales                                   | 500                                 |         |
| Radio studio   | 300                                 |         |
| Railway car mfg                                      | 200                                 |         |
| Railway station                                      | 800                                 |         |
| Railway workshop                                     | 800                                 |         |
| Record player mfg                                    | 300                                 | 200     |
| Record repository, documents see also<br>storage     | 4200                                |         |
| Refrigerator mfg                                     | 1000                                | 300     |
| Relay mfg  | 400                                 |         |
| Repair shop, general                                 | 400                                 |         |
| Restaurant   | 300                                 |         |
| Retouching department                                | 300                                 |         |
| Rubber goods mfg                                     | 600                                 | 5000    |
| Rubber goods store                                   | 800                                 |         |
| Rubber processing                                    | 600                                 | 5000    |
| <b>S</b> addlery mfg                                 | 300                                 |         |
| Safe mfg   | 80                                  |         |
| Salad oil forwarding                                 | 900                                 |         |
| Salad oil mfg  | 1000                                | 18900   |
| Sawmill (without woodyard)                           | 400                                 |         |
| Scale mfg  | 400                                 |         |
| School   | 300                                 |         |
| Scrap recovery                                       | 800                                 |         |
| Seedstore  | 600                                 |         |
| Sewing machine mfg                                   | 300                                 |         |
| Sewing machine store                                 | 300                                 |         |
| Sheet mfg  | 100                                 |         |
| Shoe factory, forwarding                             | 600                                 |         |
| Shoe factory, mfg                                    | 500                                 |         |

| Type of Occupancies                 | Fabrication<br>(MJ/m <sup>2</sup> ) | Storage |
|-------------------------------------|-------------------------------------|---------|
| Shoe polish mfg                     | 800                                 | 2100    |
| Shoe repair with manufacture        | 700                                 |         |
| Shoe store                          | 500                                 |         |
| Shutter mfg                         | 1000                                |         |
| Silk spinning (natural silk)        | 300                                 |         |
| Silk weaving (natural silk)         | 300                                 |         |
| Silverwares                         | 400                                 |         |
| Ski mfg                             | 400                                 | 1700    |
| Slaughter house                     | 40                                  |         |
| Soap mfg                            | 200                                 | 4200    |
| Soda mfg                            | 40                                  |         |
| Soldering                           | 300                                 |         |
| Solvent distillation                | 200                                 |         |
| Spinning mill excluding garmeting   | 300                                 |         |
| Sporting goods store                | 800                                 |         |
| Spray painting, metal goods         | 300                                 |         |
| Spray painting, wood products       | 500                                 |         |
| Stationery store                    | 700                                 |         |
| Steel furniture mfg                 | 300                                 |         |
| Stereotype plate mfg                | 200                                 |         |
| Stone masonry                       | 40                                  |         |
| Storeroom (workshop storerooms etc) | 1200                                |         |
| Synthetic fibre mfg                 | 400                                 |         |
| Synthetic fibre processing          | 400                                 |         |
| Synthetic resin mfg                 | 3400                                |         |
| <b>T</b> ar coated paper mfg        | 1700                                |         |
| Tar preparation                     | 800                                 |         |
| Telephone apparatus mfg             | 400                                 | 200     |
| Telephone exchange                  | 80                                  |         |
| Telephone exchange mfg              | 100                                 |         |
| Test room, electrical appliances    | 200                                 |         |
| Test room, machinery                | 100                                 |         |
| Test room, textiles                 | 300                                 |         |
| Theatre                             | 300                                 |         |
| Tin can mfg                         | 100                                 |         |
| Tinned goods mfg                    | 40                                  |         |
| Tinware mfg                         | 120                                 |         |
| Tire mfg                            | 700                                 | 1800    |
| Tobacco products mfg                | 200                                 | 2100    |
| Tobacco shop                        | 500                                 |         |
| Tool mfg                            | 200                                 |         |
| Toy mfg (combustible)               | 100                                 |         |
| Toy mfg (incombustible)             | 200                                 |         |
| Toy store                           | 500                                 |         |
| Tractor mfg                         | 300                                 |         |
| Transformer mfg                     | 300                                 |         |
| Transformer winding                 | 600                                 |         |
| Travel agency                       | 400                                 |         |
| Turnery (wood working)              | 500                                 |         |
| Turning section                     | 200                                 |         |
| TV studio                           | 300                                 |         |
| Twisting shop                       | 250                                 |         |
| <b>U</b> mbrella mfg                | 300                                 | 400     |
| Umbrella store                      | 300                                 |         |
| Underground garage, private         | >200                                |         |
| Underground garage, public          | <200                                |         |
| Upholstering plant                  | 500                                 |         |

| Type of Occupancies                 | Fabrication<br>(MJ/m <sup>2</sup> ) | Storage |
|-------------------------------------|-------------------------------------|---------|
| <b>V</b> acation home               | 500                                 |         |
| Varnishing, appliances              | 80                                  |         |
| Varnishing, paper                   | 80                                  |         |
| Vegetable, dehydrating              | 1000                                | 400     |
| Vehicle mfg, assembly               | 400                                 |         |
| Veneering                           | 500                                 | 2900    |
| Veneer mfg                          | 800                                 | 4200    |
| Vinegar mfg                         | 80                                  | 100     |
| Vulcanising plant (without storage) | 1000                                |         |
| <b>W</b> affle mfg                  | 300                                 | 1700    |
| Warping department                  | 250                                 |         |
| Washing agent mfg                   | 300                                 | 200     |
| Washing machine mfg                 | 300                                 | 40      |
| Watch assembling                    | 300                                 | 40      |
| Watch mechanism mfg                 | 40                                  |         |
| Watch repair shop                   | 300                                 |         |
| Watch sales                         | 300                                 |         |
| Water closets                       | ~ 0                                 |         |
| Wax products forwarding             | 2100                                |         |
| Wax products mfg                    | 1300                                | 2100    |
| Weaving mill (without carpets)      | 300                                 |         |
| Welding shop (metal)                | 80                                  |         |
| Winding room                        | 400                                 |         |
| Winding, textile fibres             | 600                                 |         |
| Window glass mfg                    | 700                                 |         |
| Window mfg (wood)                   | 800                                 |         |
| Wine cellar                         | 20                                  |         |
| Wine merchant's shop                | 200                                 |         |
| Wire drawing                        | 80                                  |         |
| Wire factory                        | 800                                 |         |
| Wood carving                        | 700                                 |         |
| Wood drying plant                   | 800                                 |         |
| Wood grinding                       | 200                                 |         |
| Wood pattern-making shop            | 600                                 |         |
| Wood preserving plant               | 3000                                |         |
| <b>Y</b> outh hostel                | 300                                 |         |

**APPENDIX B**

## Net Calorific Value $H_u$ of Combustible Materials (MJ/kg) from Barnett (1984)

| Solids                      | MJ/kg |
|-----------------------------|-------|
| Anthracite                  | 31-36 |
| Asphalt                     | 40-42 |
| Bitumen                     | 41-43 |
| Cellulose                   | 15-18 |
| Charcoal                    | 34-35 |
| Clothes                     | 17-21 |
| Coal, Coke                  | 28-34 |
| Cork                        | 26-31 |
| Cotton                      | 16-20 |
| Grain                       | 16-18 |
| Grease                      | 40-42 |
| Kitchen refuse              | 8-21  |
| Leather                     | 18-20 |
| Linoleum                    | 19-21 |
| Paper, Cardboard            | 13-21 |
| Paraffin wax                | 46-47 |
| Plastics                    |       |
| ABS                         | 34-40 |
| Acrylic                     | 27-29 |
| Celluloid                   | 17-20 |
| Epoxy                       | 33-34 |
| Melamine resin              | 16-19 |
| Phenolformaldehyde          | 27-30 |
| Polyester                   | 30-31 |
| Polyester, fibre reinforced | 20-22 |
| Polyethylene                | 43-44 |
| Polystyrene                 | 39-40 |
| Petroleum                   | 40-42 |
| Polyisocyanurate foam       | 22-26 |
| Polycarbonate               | 28-30 |
| Polypropylene               | 42-43 |
| Polytetrafluoroethylene     | 5.0   |
| Polyurethane                | 22-24 |
| Polyurethane foam           | 23-28 |
| Polyvinylchloride           | 16-17 |

|   |       |
|---|-------|
| Ureaformaldehyde                        | 14-15 |
| Ureaformaldehyde foam                   | 12-15 |
| Foam rubber                             | 34-40 |
| Rubber (isoprene)                       | 44-45 |
| Rubber tire                             | 31-33 |
| Silk                                    | 17-21 |
| Straw                                   | 15-16 |
| Wood                                    | 17-20 |
| Wool                                    | 21-26 |
| Particleboard (chipboard and hardboard) | 17-18 |

---

| <b>Liquids</b>    | <b>MJ/kg</b> |
|-------------------|--------------|
| Gasoline          | 43-44        |
| Diesel oil        | 40-42        |
| Linseed oil       | 38-40        |
| Methanol          | 19-20        |
| Paraffin oil      | 40-42        |
| Spirits           | 26-28        |
| Tar               | 37-39        |
| Benzene           | 40.1         |
| Benzyl alcohol    | 32.9         |
| Ethyl alcohol     | 26.9         |
| Isopropyl alcohol | 31.4         |

---

| <b>Gases</b>    | <b>MJ/kg</b> |
|-----------------|--------------|
| Acetylene       | 48.2         |
| Butane          | 45.7         |
| Carbon monoxide | 10.1         |
| Hydrogen        | 119.7        |
| Propane         | 45.8         |
| Methane         | 50.0         |
| Ethanol         | 26.8         |

APPENDIX C



| BRANZ FIRE LOAD SURVEY |              | A : BASIC DESCRIPTION OF CONSTRUCTION |  |
|------------------------|--------------|---------------------------------------|--|
| Sample No.             | Sample Group |                                       |  |
| Date of Survey         | Location     |                                       |  |
| Framework              |              |                                       |  |
| Floors                 |              |                                       |  |
| Walls                  |              |                                       |  |
| Ceilings               |              |                                       |  |
| Roof                   |              |                                       |  |
| Doors and Windows      |              |                                       |  |
| Covering               | Floors :     |                                       |  |
|                        | Walls :      |                                       |  |
|                        | Ceilings :   |                                       |  |
| Electrical Equipment   |              |                                       |  |
| Miscellaneous          |              |                                       |  |

BRANZ FIRE LOAD SURVEY

B : DRAWING SHEET

Sample No.

Sample Group

Date of Survey

Location

|  |  |
|--|--|
|  |  |
|--|--|

|                        |                       |
|------------------------|-----------------------|
| BRANZ FIRE LOAD SURVEY | C : CALCULATION SHEET |
|------------------------|-----------------------|

| Sample No.     | Sample Group |
|----------------|--------------|
| Date of Survey | Location     |

|  |  |
|--|--|
|  |  |
|--|--|



BRANZ FIRE LOAD SURVEY

E: MOVABLE FIRE LOAD SHEET

Sample No.


Sample Group

Date of Survey

Location

| No  | Designation and description of Fixed Fire Load | Type | Plan A<br>m <sup>2</sup> | Vol V<br>m <sup>3</sup> | Wt W<br>kg | Furniture         |       |         |        | Contents          |       |         |        |
|---|--|------|--------------------------|-------------------------|------------|-------------------|-------|---------|--------|-------------------|-------|---------|--------|
|   |  |      |                          |                         |            | Q                 | Units | Unit/MJ | Tot MJ | Q                 | Units | Unit/MJ | Tot MJ |
|   |  |      |                          |                         |            |                   |       |         |        |                   |       |         |        |
|   |  |      |                          |                         |            |                   |       |         |        |                   |       |         |        |
|   |  |      |                          |                         |            |                   |       |         |        |                   |       |         |        |
|   |  |      |                          |                         |            |                   |       |         |        |                   |       |         |        |
|   |  |      |                          |                         |            |                   |       |         |        |                   |       |         |        |
|   |  |      |                          |                         |            |                   |       |         |        |                   |       |         |        |
|   |  |      |                          |                         |            |                   |       |         |        |                   |       |         |        |
|   |  |      |                          |                         |            |                   |       |         |        |                   |       |         |        |
|   |  |      |                          |                         |            |                   |       |         |        |                   |       |         |        |
|   |  |      |                          |                         |            |                   |       |         |        |                   |       |         |        |
|   |  |      |                          |                         |            |                   |       |         |        |                   |       |         |        |
|   |  |      |                          |                         |            |                   |       |         |        |                   |       |         |        |
|   |  |      |                          |                         |            |                   |       |         |        |                   |       |         |        |
|   |  |      |                          |                         |            |                   |       |         |        |                   |       |         |        |
|   |  |      |                          |                         |            |                   |       |         |        |                   |       |         |        |
|   |  |      |                          |                         |            |                   |       |         |        |                   |       |         |        |
|   |  |      |                          |                         |            |                   |       |         |        |                   |       |         |        |
| Total Gross Heat Load for _____ m <sup>2</sup>                          |  |      |                          |                         |            |                   |       |         |        |                   |       |         |        |
|   |  |      |                          |                         |            |                   |       |         |        |                   |       |         |        |
| Unit Movable Fire Load  |  |      |                          |                         |            |                   |       |         |        |                   |       |         |        |
| P = Plastic    S = Sheepwool    W = Wood    WM = Wood - metal furniture |  |      |                          |                         |            |                   |       |         |        |                   |       |         |        |
|   |  |      |                          |                         |            | MJ/m <sup>2</sup> |       |         |        | MJ/m <sup>2</sup> |       |         |        |





Fire severities for structural fire  
engineering design.  
NARAYANAN, P. *Copy 7*  
Dec 1995 34313



## **BRANZ MISSION**

To be the leading resource for the development of the building and construction industry.

## **HEAD OFFICE AND RESEARCH CENTRE**

Moonshine Road, Judgeford  
Postal Address - Private Bag 50908, Porirua  
Telephone - (04) 235-7600, FAX - (04) 235-6070

## **REGIONAL ADVISORY OFFICES**

### **AUCKLAND**

Telephone - (09) 524-7018  
FAX - (09) 524-7069  
118 Carlton Gore Road, Newmarket  
PO Box 99-186, Newmarket

### **WELLINGTON**

Telephone - (04) 235-7600  
FAX - (04) 235-6070  
Moonshine Road, Judgeford

### **CHRISTCHURCH**

Telephone - (03) 366-3435  
FAX - (03) 366-8552  
GRE Building  
79-83 Hereford Street  
PO Box 496