

THE RESOURCE CENTRE FOR BUILDING EXCELLENCE

AcN 31783  
B24077

CI/SfB

(21.4) | Ro | (J4)

Date




# REPRINT

NO. 123 (1993)

## THE RACKING BEHAVIOUR OF CURTAIN WALL GLAZING DURING SIMULATED EARTHQUAKE

A. B. King and S. J. Thurston

From Proceedings of the Tenth  
World Conference on Earthquake  
Engineering, 19-24 July 1992,  
Madrid, Spain

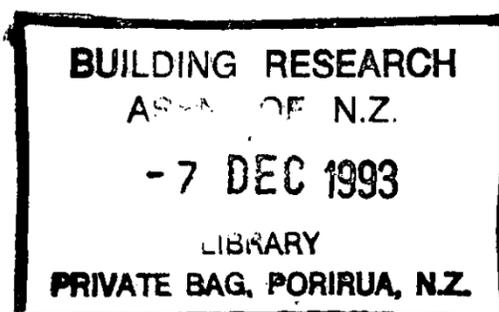

ISSN: 0111-7459

PROCEEDINGS

of the

TENTH

WORLD

CONFERENCE

on

EARTHQUAKE

ENGINEERING

19-24 July 1992

Madrid

Spain

OFFPRINT



**Published by**

A.A.Balkema / Rotterdam / Brookfield / 1992

# The racking behaviour of curtain wall glazing during simulated earthquake

Andrew B. King & Stuart J. Thurston

Building Research Association of New Zealand (BRANZ), New Zealand

**ABSTRACT:** This paper reviews a three year research programme which focused on assessing the behaviour of curtain wall glazing systems when subjected to simulated interstorey drift as may be expected to occur during the response of multi-storey buildings to earthquake attack. The paper reviews the laboratory testing programme undertaken which examined the behaviour of several different types of curtain wall glazing which were subjected to racking actions. Both planar specimens and two-dimensional (corner) specimens were tested. Recommendations are made as to laboratory test methods which could be used to assess the behaviour of curtain wall systems to be erected in earthquake prone areas.

## 1 BACKGROUND

This project evolved following public concern about the safety of four-sided silicone curtain wall glazing systems during earthquakes. The scope of the project was expanded to include various other types of curtain wall glazing for comparison.

The project has been undertaken in three phases. The first involved a review of overseas practices with regard to the behaviour of such systems during earthquakes and the formulation of a proposed method of test. The findings were published by Wright (1989). The second phase involved fabricating a full-scale mock exterior wall in the laboratory, cladding this with different types of curtain wall glazing, and subjecting each to interstorey displacements simulating the response of buildings to earthquake attack. The project was extended to a third phase with the fabrication of several mock "corner" specimens, with two sliding frames simulating in-plane distortion in two orthogonal directions.

A standard laboratory test method and evaluation procedure is being prepared based upon the findings from the research undertaken. This will enable the ability of specific curtain wall glazing systems to withstand given interstorey displacements to be assessed within the laboratory.

## 2 THE EXPERIMENTAL PROGRAMME

### 2.1 Glazing Systems Investigated

Four generic types of glazing systems were subjected to in-plane racking testing and are considered in this paper.

1. neoprene gasket dry-glazed systems

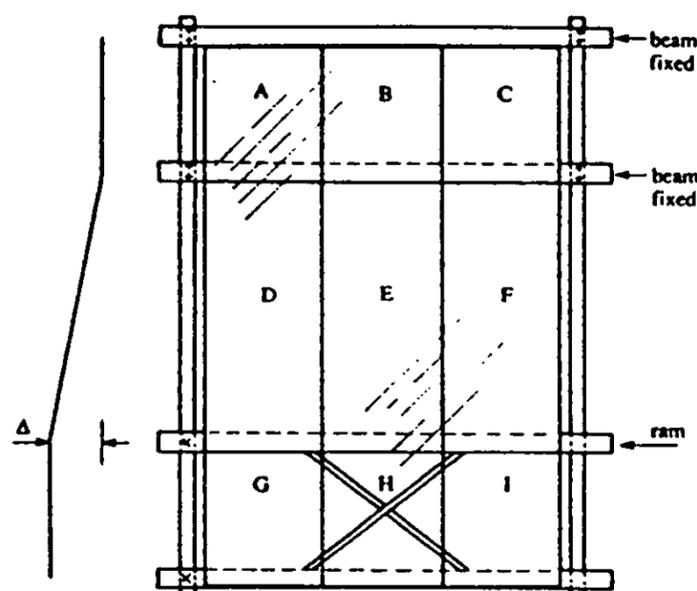


Figure 1: Single storey specimen with zero adjacent interstorey drift (configuration zs).

2. unitised 4-sided structural silicone glazed systems,
3. a two-sided silicone glazed system
4. mechanically fixed patch plate systems (with toughened glass)

### 2.2 Parameters Considered

1. Specimen Configuration: The planar test rig was able to accept specimens up to 3.6 m in length, having either a two storey configuration (identified as "d") or a single storey with two half storeys (identified as "s"). Corner specimens were 2.4 m in each wall plane, and of an "s" configuration.

2. Displacement Profiles: The test rig was designed to induce the nominated interstorey displacement over the height of the test panels and either zero displacement

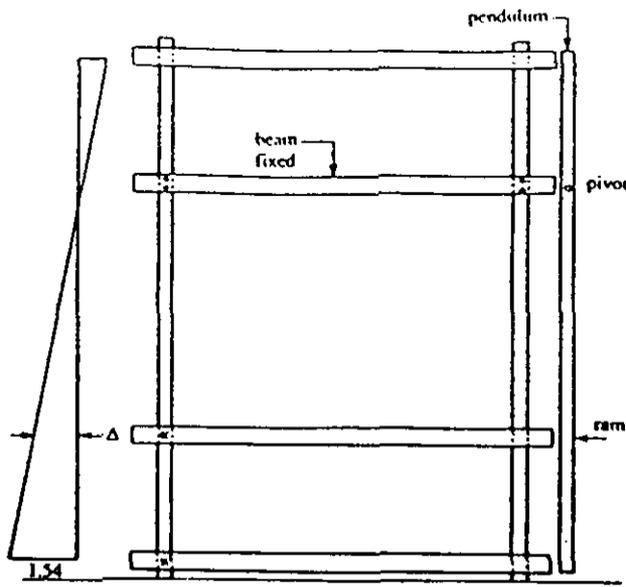


Figure 2: Single storey specimen with full adjacent interstorey drift (configuration fs).

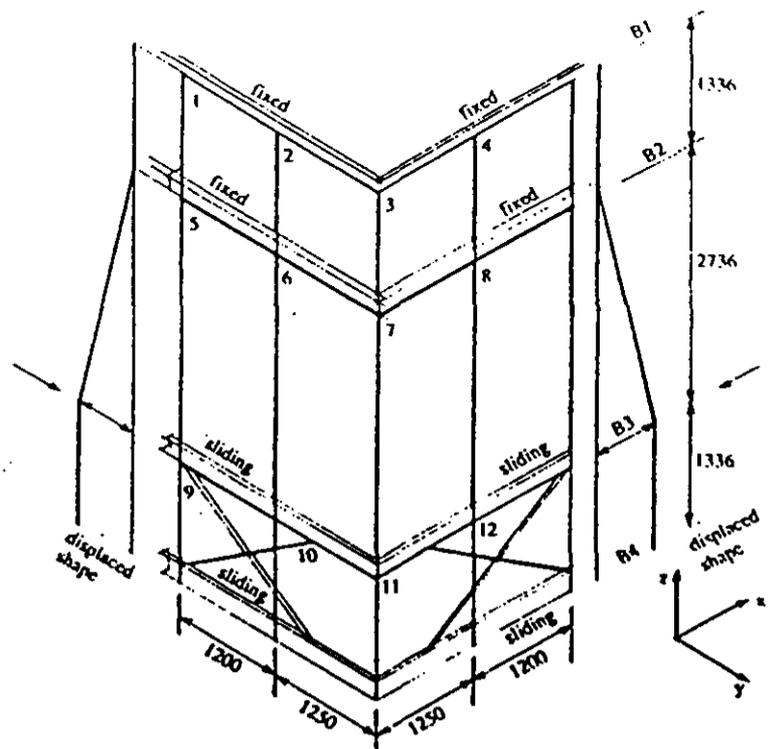


Figure 5: Corner specimen with zero adjacent interstorey drift (configuration cf).

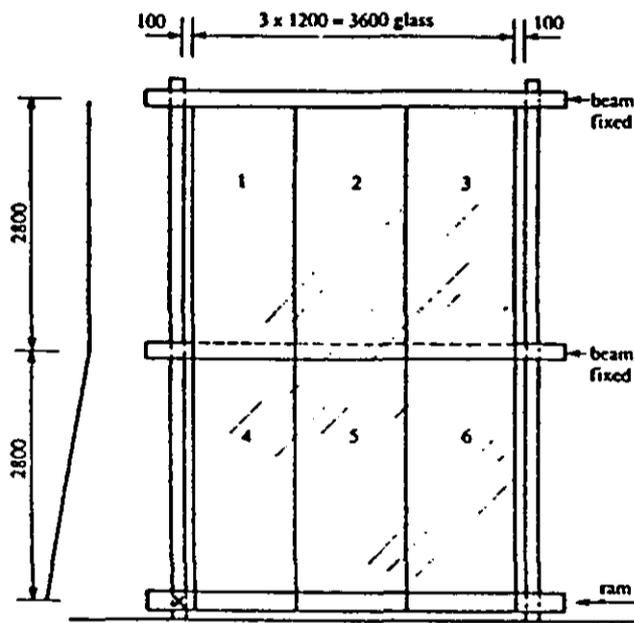


Figure 3: Double storey specimen with zero adjacent interstorey drift (configuration zd).

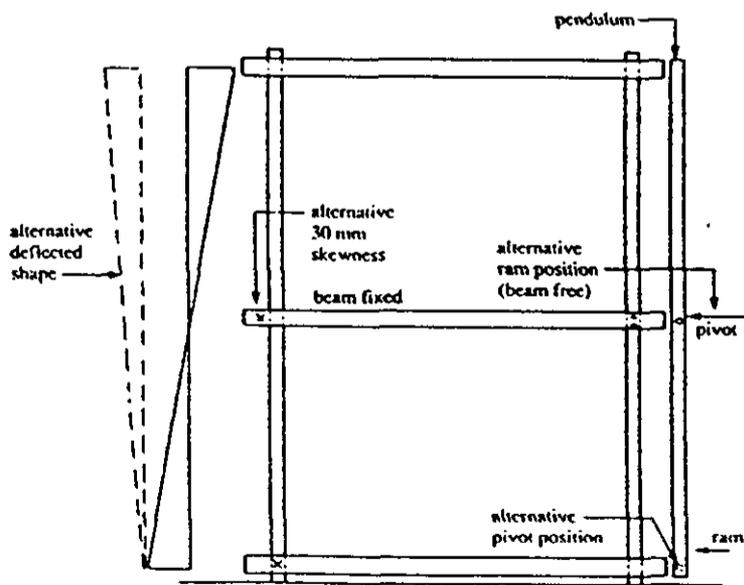


Figure 4: Double storey specimen with full adjacent interstorey drift (configuration zf).

over adjacent panels (identified as profile "z") or equal displacements in adjacent panels (i.e., a linear profile - identified as profile "f")

(Note: the displacement profile and specimen configuration are detailed in figures 1 to 5).

3. The effect of different rates of racking displacement
4. An indication of the effect of out-of-plane skewness.

### 2.3 Failure criterion

Failure was deemed to occur when in excess of 5% of the mass of glass supported in any frame fell from that frame. At this juncture it was considered that falling glass would significantly increase the risk of injury to people in and around the building.

### 2.4 Test Procedure

The procedure involved cyclically displacing the "floor" beam (sliding steel beams) to a designated displacement at a uniform displacement rate, and to repeatedly cycle to this nominated peak displacement as required. The peak displacement was increased by the appropriate increment, and the procedure repeated. Movement was initiated using hydraulic actuator operating under displacement control. A second actuator was introduced during testing of the corner specimens.

Both the dry glazed and the 4-sided silicone systems were tested in each configuration and subjected to both displacement profiles as planar specimens. They were also tested as corner elements.

Different two-sided silicone system was tested in configuration "s" with displacement profile "z" in the planar and the corner rig.

The patch plate system, glazed with 6 mm toughened glass, was tested in all configurations and subjected to both displacement profiles, but was limited to only the planar rig.

### 3 OBSERVATIONS AND RESULTS

#### 3.1 General

All systems tested proved to be considerably more resilient to interstorey displacements than had been anticipated. One of two mechanisms developed in all cases; either pane rotation within skewed frames (sometimes accompanied by mullion twisting), or a slip plane developed enabling frames to slide relative to each other.

The results of the planar testing are published by Lim and King (2). A summary of these is listed in Table 1. The several instances where glass fracture did not occur are noted as "No failure".

#### 3.2 Gasket Glazed System

Interstorey displacements in excess of 100 mm (0.04 H) were achieved without failure in all configurations. The panes were observed first to rotate within their frames (the glass was installed on neoprene packing blocks and had a clearance of 17mm clearance before coming into contact with the frame). The aspect ratio of the panes tested was approximately 2.3:1. It was calculated that, for this geometry and clearance, contact between glass and framed would occur at an interstorey drift of approximately 140 mm with the presence of the spacer blocks being ignored.

The gaskets were observed to work loose from the frame during repeated cycling in excess of 15 mm interstorey drift. The onset of such behaviour appeared to be a function of the number of displacement reversals. When this occurred during the early stages of the test, the test was stopped and the gaskets re-instated. Once displacements exceeded 60 mm, gasket extraction was ignored and the incremental displacement continued until failure.

Failure occurred during the 120 mm and 100 mm peak amplitude cycling for the single and double configurations respectively were achieved without failure. In each case it was preceded by the loss of the gasket and the subsequent clashing of the glass and mullion because of misalignment. The glass typically developed a "scallop shaped" crack in one corner, which rapidly developed into multiple cracks and eventual (typically after a further one to three displacement exertions) the glass fell from the frame.

The corner specimen demonstrated similar pane rotation. Failure occurred in the corner pane (pane 7 in figure 5) at an in-plane interstorey displacement of 85 mm. Prior to this, the corner mullion cover plate separated and fell from the system. This is a light component and its detachment was not considered to create significant additional hazard and therefore did not fulfil the failure criteria (indicated above). One significant difference observed between the planar and corner specimens, was

that in the former tests, significant twisting along the axis of the mullion was noted. This was caused by eccentricities between the "floor" and the plane of the glass (over a distance of 125 mm). Such twisting was measured as amounting to up to 40 mm of the induced peak displacement. This action was not present in the corner specimen because of the connections of the framing members at the corner mullion.

#### 3.3 Patch Fitting System

The patch plates tested were detailed to allow joint rotation in an attempt to alleviate localised stress concentrations anticipated at the connection points. The detail involved a combination of rotating and sliding mechanisms being incorporated into the patch fitting. While these mechanisms were observed, failure of the toughened glass occurred when the mechanism had displaced to but half of the available movement potential of the fixing. Furthermore, when constrained to distort in the "z" displacement profile, back plate rotation (which had been identified as one of the secondary displacement mechanisms) was prevented at the quadruple patch fitting. Failure occurred at an interstorey displacement of 40 mm (0.012 H). Scrutiny of slow-motion video replays of the failure, identified that failure was typically initiate at one fixing points. The toughened glass shatter pattern rapidly spread across the panel. The glass mass was observed to fall from the frame in coherent fragments assessed to measure 0.5 m by 0.9 m, which shattered onto small (10 x 10 mm) glass granules on impact with the floor.

#### 3.4 Two-Sided Silicone System - Planar specimen

Different systems were used for the planar test specimen and the corner specimen. The planar system was factory assembled and involve structural silicone joints between each glass pane and the supporting mullion. The mullion was formed from an "I" shaped aluminium section on to which an aluminium box section "glazing bar" was fixed using stainless steel screws. Transom support was by conventional entrapment of the glass into a aluminium "T" section with support by dry-glazing (neoprene gasket) techniques.

At 25 mm, the glass was observed to distort the silicone joint relative to the mullions characteristic of vertical shear along this joint. The mullions were observed rotate about their splice points (at h/4 within the test panel).

At peak displacements of 60mm, the screws fastening the glazing bar to the mullion failed, some in shear and others by head pull-through after which the glazing panels were free to slide over the face of the mullion while remaining entrapped by the transom. Once screw fracture had occurred, the resistance to displacement dropped markedly and the glass slid within the transom. Glass failure could not be initiated.

Table 1. Summary of Planar Specimen Results

Test	Peak Load (kN)	Max. interstorey displacement (mm)	Failure mode
Gasket system Config "s" Profile "f"	16	120	Glass fracture Following pane rotation
Gasket system Config "s" Profile "f"	14	100	Glass fracture to Following pane rotation
Patch plates Config "s" Profile "z"	17.5	40	Toughened pane shattered
Patch plates Config "s" Profile "f"	11	60	Toughened pane shattered
2-sided silicone Config "s" Profile "f"	12	120	No failure; sub-mullion slip
4-sided silicone Config "s" Profile "f"	15	80	Glass cracked but did not fall Severe frame distortion at slip pane
4-sided silicone Config "d" Profile "f"	10	90	No failure; severe frame distortion at slip plane

### 3.5 Two-sided Silicone System - Corner Specimen

The corner specimen was unitised (factory installed into aluminium frames which mechanically interlocked on site). Structural silicone was used to adhere the glass to the mullions. The transom/glass connection maintained a mechanical entrapment with neoprene gasket seals. Both mullion and transom interlocked with their respective neighbours each with p.v.c. strip seals providing appropriate weather seals within the interlocking aluminium sections.

Little movement was observed between the glass and frame when compared to the dry-glazed system. Most movement was accommodated by rotation of the complete unitised frame, and by relaxation of the frame to "floor" connections. The frame rotation was particularly dominant in each corner pane (panes 6 and 7 of figure 5). Such rotational freedom is thought to have minimised internal stresses within these panes.

An initial crack was observed to develop in panel 8 (refer figure 5) at an interstorey displacement of 80 mm. A substantial portion of glass fell from this frame during the subsequent 100 mm interstorey displacement cycle.

### 3.6 Unitised Four-Sided Silicone System

The four-sided silicone panels were subjected to displacements in excess 80 mm (0.03H) without "failure". The shear distortion was accommodated by a combination of slip between the units, and relaxation of the support brackets. At high drift levels, the complete panels were observed to rotate (being eccentrically supported) at which stage the panels disengaged from each other (Figure 6). One of the glass panes developed a diagonal crack (within the upper half of the panel) as a result of out-of-plane distortion which occurred following this disengagement. The glass remained attached to the frame through the silicone and therefore did not fulfil the "failure" criteria.

## 4 DISCUSSION

### 4.1 Corner Effects

The behaviour of the corner specimens was consistent with that observed for compatible planar systems except

that the development of slip lines was inhibited by the two-way action required at the corners. It is reasonable to limit the standard test regime to planar systems only, while intentionally restricting any such slip development.

#### 4.2 Specimen Configuration

The single storey (with two half storey) configuration most appropriately simulated actual building response, and, when accompanied by the most severe limit of zero displacement of adjacent storeys, resulted in the most severe distortion of the test panels. This configuration along will be sufficient for any standard laboratory test method.

#### 4.3 Displacement Rate

The rate of loading was only significant when very slow. This was particularly significant a friction mechanism developed. Displacement rates greater than 5 mm/sec are sufficient to overcome this variation and gave consistent results.

#### 4.4 Effect of Skewness

It was recognised that the use of a static skew, such as the packer used in this series of test, simplified the effect of out of plane motion to the extreme. Such simplicity was necessary because of the modelling constraints under which the systems was tested. Within these limitations however, it was predicted that out-of-plane distortion (twisting) had little effect on either the sustainable stress level or the behaviour of the panels. (Note further investigation into this issue is currently proceeding with the third phase of testing associated with the investigation into corner effects).

### 5 CONCLUSIONS

Some forms of curtain wall glazing systems are able to withstand very large interstorey in-plane shear displacements without damage.

This ability varies markedly with different types of systems. This ability may be assessed by laboratory testing full-scale specimens.

Sliding or rotation mechanisms, either of the glass or the complete frame were generally tolerant to racking. Stress concentrations, such as those associated with patch fitting systems, require careful consideration.

Slow displacement rates should be avoided during racking tests of glass systems. However, provided the rate of displacement is moderate ( $> 10$  mm/sec) the results are not sensitive to the rate of displacement.



Figure 6: Four sided unitised panels.

### 6 ACKNOWLEDGEMENTS

The authors acknowledge the grants from the Earthquake and War Damage Commission and from the Foundation for Science Research and Technology for this project. The authors also wish to thank Adlite (1988) Limited; New Zealand Aluminium Franchising; Thermosash Commercial Limited; Winstone Architectural Cladding; Winstone Glass, and Upton and Shearer (Nebulite) and Horizon Aluminium Ltd for supply of component for this project.

### REFERENCES

- Lim, K.Y.S. & A.B. King 1991. The Behaviour of External Glazing Systems Under Seismic In-Plane Racking, BRANZ Study Report No. 39. Judgeford, New Zealand.
- Wright, P.D. 1989. The development of a procedure and rig for testing the racking resistance of curtain wall glazing. BRANZ Study Report No. 17. Judgeford, New Zealand.

FROM THE SAME PUBLISHER:

Juhasová, Emilía (ed.) 90 5410 006 0  
**Earthquake engineering – Proceedings of the 16th regional European conference, Stará Lesná, Czechoslovakia, 6–12 October 1991**  
 (No rights Poland & Czechoslovakia)  
 1992, 25 cm, 292 pp., Hfl. 145 / \$80.00 / £45

The 30 papers included in these proceedings present a state-of-the-art information on the design and analysis of earthquake resistant structures. They cover a wide range of topics including: Past earthquakes; The structures which have survived the past earthquakes; Seismic design of structures, the ways of seismic strengthening of existing structures; Seismic response reduction systems and seismic isolation; Softwares available for seismic calculation and design; Recommended structural solutions for more seismic resistant structures; Seismic codes.

Savidis, S.A. (ed.) 90 6191 161 3  
**Earthquake resistant construction and design – Proceedings of an international conference, Berlin, 13–16 June 1989**  
 1991, 25 cm, 800 pp., Hfl. 165 / \$90.00 / £52

Geotechnical earthquake engineering; Construction & design of structures in seismic regions; Projects in developing countries; Seismic risk in the Mediterranean region.

Abdullabekov, K. N. (R. B. Zeidler, transl.) 90 6191 171 0  
**Electromagnetic phenomena in the earth's crust**  
 (*Elektromagnitnye yavleniya v zemnoy kore*, Tashkent, 1989)  
 1991, 25 cm, 160 pp., Hfl. 95 / \$52.00 / £30

Stresses in the earth's crust & their appearance in seismotectonic processes & in magnetic field changes of the earth; Prototype measurements of magnetic field at variable loading; Tectonogeological & geophysical characteristics of Central Asia, & selection of geodynamical test areas; Techniques of magnetometric investigations in Uzbekistan; Mesoscale variations of magnetic field in geodynamic test areas at stationary stations in Uzbekistan; Fast changes in the earth's magnetic field; Comprehensive analysis of results of electromagnetic measurements in Uzbekistan; Magnetometric prediction of earthquakes; Bibliography. Author: Inst. Seismology, Uzbek Academy of Science.

**Earthquake engineering: Fifth Canadian conference – Proceedings, Ottawa, 6–8 July 1987 / Génie sismique: Cinquième conférence canadienne – Comptes-rendus, Ottawa, 6–8 juillet 1987** 90 6191 735 2  
 1987, 25 cm, 896 pp., Hfl. 270 / \$149.00 / £83

Ground motion, seismicity & seismic risk; Seismic codes & standards; Soil stability, soil structure interaction; Response analysis & design of structures & structural components; Experimental methods & tests; Special structures & critical facilities; Lifeline, utility, telecommunication, & transportation systems; Observed behaviour during earthquakes.

**Soviet advances in applied geophysics** 90 6191 139 7  
 1990, 25 cm, 130 pp., Hfl. 95 / \$52.00 / £30 (No rights India)

Algorithm for calculating kinematic characteristics of seismic waves; Generation & application of seismic travel time anomalies; Interpretation of velocities; Analysis of formulae for conversion of effective velocities into limiting & average velocities; Application of frequency sounding IP for oil exploration in Timano-Pechork province; etc.

Krätzig, W.B. et al. 90 6191 168 0  
**Structural dynamics – Proceedings of the first European conference, Bochum, 5–7 June 1990**

1991, 25 cm, 1268 pp., 2 vols, Hfl. 285 / \$158.00 / £90  
 Impact; Dynamic stability; Soil dynamics; System identification; Earthquake engineering; R/C Structures; Steel structures; Stochastic dynamics; Soil-structure-fluid-interaction; Numerical modelling & computational aspects; Material & system properties; Wind engineering.

Tseitlin, A. I. & A. A. Kusainov 90 6191 959 2  
**Role of internal friction in dynamic analysis of structures**  
 (Russian translations series, 80) (No rights India)

1990, 24 cm, 223 pp., Hfl. 115 / \$64.00 / £35  
 Modern methods of dynamic analysis of structures through the application of frequency-independent damping models. Experimental data, justification for the models used in the norms & computer analysis & solutions to design problems. Economical & reliable design of structures subjected to explosive, seismic, wind & other loads.

Fairhurst, Charles (ed.) 90 6191 145 1  
**Rockbursts and seismicity in mines – Proceedings of the 2nd international symposium, Minneapolis, Minnesota, 8–10.06.1988**  
 1990, 30 cm, 456 pp., Hfl. 150 / \$85.00 / £47

The most up-to-date and comprehensive account of current knowledge on the important problem of rockbursts; A problem likely to increase in frequency and severity as extraction of minerals is pursued to ever-greater depths. Mechanics of seismic events & rock bursts; Monitoring of seismicity & seismic networks; Coal mining bumps; Rock stress, structure & mine design; Rockburst hazard mitigation/ground control. 61 papers.

Knoll, P. 90 5410 115 6  
**Induced seismicity**  
 1992, 25 cm, 480 pp., Hfl. 160 / \$88.00 / £50

Induced seismicity is at present a scientific field and a problem of great actuality. Their phenomenon is a result of the interaction of technology and the behaviour of the uppermost strata of the earth crust. So its controlling is a special part of the protection of the environment. In the book some of the latest advantages in the field of induced seismicity are concentrated for mining-induced, reservoir-induced, injection-induced, and extraction-induced seismicity. There are case studies, generalisations of different investigations of the rock-mechanical & seismological mechanism, result of modelling & monitoring as well as geophysical and rock-mechanical fundamentals from different regions of the world. The book is very valuable for scientists, engineers and students to get new data sets, advanced knowledge about reasons and prerequisites of induced seismicity and results in controlling the effects caused by induced seismicity. Author: Zentralinstitut für Physik der Erde, Potsdam, Germany.

Zakharova, A. I. 90 6191 461 2  
**Estimation of seismicity parameters using a computer**  
 (Russian translations series, 46) (No rights India)

1986, 24 cm, 158 pp., Hfl. 95 / \$50.00 / £30  
 Methodology for machine calculations of the main seismicity indices, computer programs to evaluate recurring earthquakes.

*All books available from your bookseller or directly from the publisher:  
 A.A. Balkema Publishers, P.O. Box 1675, Rotterdam, Netherlands  
 For USA & Canada: A.A. Balkema Publishers, Old Post Rd, Brookfield, VT, USA*

Copy 1

B24077  
0031783  
1993

The racking behaviour of  
curtain wall glazing duri

---



## **BRANZ MISSION**

To promote better building through  
the application of acquired knowledge,  
technology and expertise.

## **HEAD OFFICE AND RESEARCH CENTRE**

Moonshine Road, Judgeford  
Postal Address - Private Bag 50908, Porirua  
Telephone - (04) 235-7600, FAX - (04) 235-6070

## **REGIONAL ADVISORY OFFICES**

### **AUCKLAND**

Telephone - (09) 524-7018  
FAX - (09) 524-7069  
118 Carlton Gore Road, Newmarket  
PO Box 99-186, Newmarket

### **WELLINGTON**

Telephone - (04) 235-7600  
FAX - (04) 235-6070  
Moonshine Road, Judgeford

### **CHRISTCHURCH**

Telephone - (03) 366-3435  
FAX - (03) 366-8552  
GRE Building  
79-83 Hereford Street  
PO Box 496